



ATTACHMENT D.10
NOISE ANALYSIS



Noise Analysis for the
Santa Fe Flores Townhomes Project
San Marcos, California

Project Nos. GPA25-0001, R25-0001, MFSDP25-0001, and
TSM25-0001

Prepared for
Santa Fe Flores, LP
P.O. Box 903
Rancho Santa Fe, CA 92067
Contact: Paul Mayer

Prepared by
RECON Environmental, Inc.
3111 Camino del Rio North, Suite 600
San Diego, CA 92108
P 619.308.9333

RECON Number 10587
January 28, 2026

A handwritten signature in black ink that reads "Jessica Fleming".

Jessica Fleming
Senior Air Quality/Noise/GHG Specialist

TABLE OF CONTENTS

Acronyms and Abbreviations.....iii

Executive Summary..... 1

1.0 Introduction..... 3

 1.1 Project Description 3

 1.2 Fundamentals of Noise 7

2.0 Applicable Noise Standards..... 8

 2.1 General Plan..... 8

 2.2 Municipal Code..... 9

 2.3 California Green Building Standards Code – Environmental Comfort 10

3.0 Existing Conditions 10

4.0 Analysis Methodology 13

 4.1 Construction Noise Analysis..... 13

 4.2 Traffic Noise Analysis..... 14

 4.3 On-site Generated Noise Analysis..... 16

5.0 Future Acoustical Environment and Impacts.....17

 5.1 Construction Noise..... 17

 5.2 Traffic Noise..... 18

 5.3 On-site Generated Noise.....23

6.0 Conclusions.....25

 6.1 Construction Noise.....25

 6.2 Traffic Noise.....26

 6.3 On-site Generated Noise.....26

7.0 References Cited27

FIGURES

1: Regional Location4

2: Project Location on Aerial Photograph 5

3: Site Plan..... 6

4: Noise Measurement Locations 12

5: Construction Noise Contours..... 19

6: Future Vehicle and Rail Traffic Noise Contours..... 19

7: HVAC Noise Contours 24

TABLE OF CONTENTS (cont.)

TABLES

1: Interior and Exterior Noise Guidelines 9

2: Municipal Code Property Line Noise Standards 10

3: Noise Measurements 11

4: 15-minute Traffic Counts 11

5: Typical Construction Equipment Noise Levels 13

6: Modeled Vehicle Traffic Parameters 15

7: Modeled Sprinter Trains 15

8: Future Vehicle Traffic Parameters 16

9: Construction Noise Levels 17

10: Future Vehicle and Rail Traffic Noise Levels 21

11: Traffic Noise Level with and without Project and Ambient Noise Increases 23

12: HVAC Noise Levels at Adjacent Properties 25

ATTACHMENTS

- 1: Noise Measurement Data
- 2: HVAC Specifications
- 3: SoundPLAN Data – Construction Noise
- 4: SoundPLAN Data – On-site Traffic and Rail Noise
- 5: Fresnel Barrier Reduction Calculations
- 6: FHWA RD-77-108 – Off-site Traffic Noise
- 7: SoundPLAN Data – On-site Generated Noise

Acronyms and Abbreviations

APN	assessor parcel number
Caltrans	California Department of Transportation
CCR	California Code of Regulations
City	City of San Marcos
CNEL	community noise equivalent level
dB	decibel
dB(A)	A-weighted decibel
FHWA	Federal Highway Administration
GPA	General Plan Amendment
HVAC	heating, ventilating, and air conditioning
L ₉₀	noise level exceeded 90 percent of the time
L _{eq}	one-hour equivalent noise level
LLG	Linscott, Law & Greenspan, Engineers, Inc.
L _{max}	maximum noise level
L _{pw}	sound power level
MND	Mitigated Negative Declaration
project	Santa Fe Flores Townhomes Project
STC	sound transmission class

Executive Summary

The Santa Fe Flores Townhomes Project (project) is located in the city of San Marcos at 2966, 2972, and 2982 South Santa Fe Avenue, adjacent to North Las Flores Drive. The 2.6-acre (net) project site is comprised of assessor parcel numbers (APNs) 217-161-18, 217-161-19, and 0.37 acres of APN 217-161-17. The project would require a General Plan Amendment (GPA) and Rezone to allow the development of 46 multi-family residential townhome units. The project also proposes approximately 0.12 acres of off-site improvements, including the construction of a new shared driveway extending into the southern portion of APN 217-161-17, upgrades to the existing liquor store parking lot, and landscaping within the 8-foot-wide irrevocable offer of dedication area along the project frontage. The liquor store, Gourmet Liquor, located on the southern portion of APN 217-161-17 is not part of the project and would remain.

This report discusses potential noise impacts from the construction and operation of the project. As part of this assessment, noise levels due to vehicle traffic were calculated and evaluated against City of San Marcos (City) noise and land use compatibility guidelines. In addition to compatibility, the potential for noise to impact adjacent uses from future on-site sources and construction activity was assessed. A summary of the findings is provided below.

Construction Noise

Construction activity is regulated by the City Municipal Code, which limits noise by restricting construction activities to hours unlikely to impact the community. Noise associated with the grading, building, and paving for the project would potentially result in short-term impacts to surrounding residential properties. Construction noise levels would range from 56 to 73 A-weighted decibels equivalent noise level (dB(A) L_{eq}) at the adjacent properties. Construction activities would generally occur over the period between 7:00 a.m. and 6:00 p.m. on weekdays. Although the existing adjacent uses would be exposed to construction noise levels that may be heard above ambient conditions, the exposure would be temporary and would not exceed 75 dB(A) L_{eq} . As construction activities associated with the project would comply with Section 10.24.020 (b)(9) of the City Municipal Code, temporary increases in noise levels from construction activities would be less than significant.

Traffic Noise

The additional vehicle trips associated with the project would increase noise levels on nearby roadways. A noise increase of 3 dB or more would be considered significant because 3 dB is the level at which an increase in noise is perceptible to a person. However, the project would not generate enough trips to result in a direct or cumulative noise increase of more than 3 dB. Therefore, the project would result in less than significant direct and cumulative impacts related to traffic noise.

The main source of noise at the project site is vehicle traffic on South Santa Fe Avenue and North Las Flores Drive as well as Sprinters on the adjacent rail line. Exterior noise levels were modeled at the project site to determine compatibility with City standards. The applicable standards for multi-family uses are an exterior noise level of 65 community noise equivalent level (CNEL) and an

interior noise level of 45 CNEL. The project's exterior useable spaces include second- and third-floor balconies, roof decks, and the five amenity areas located on the south side of Building 1, on the north side of Building 2, on the east side of Building 4, on the north side of Building 5, and between Buildings 6 and 7. These amenity areas consist of active play areas and passive gathering space. As calculated in this analysis, without consideration of any noise barriers, exterior noise levels are projected to range from 42 to 70 CNEL at the building façades and amenity areas. Noise levels would be compatible with the City's exterior multi-family noise level standard of 65 CNEL at all locations except the amenity area on the south side of Building 1 (Amenity Area A, Receiver 1) and the south and east sides of Building 1 facing the roadways (Receivers 8 and 9). In order to reduce noise levels at these locations, the project would include a 6-foot barrier adjacent to the amenity area south of Building 1, and a solid 3.5-foot barrier on the balconies located on the south and east sides of Building 1 and on the south and east sides of the Building 1 roof deck. With construction of these barriers, exterior noise levels would be reduced to less than 65 CNEL and exterior noise impacts would be less than significant.

The interior noise level standard is 45 CNEL. Interior noise levels can be reduced through standard construction techniques. When windows are closed, standard construction techniques provide various exterior-to-interior noise level reductions depending on the type of structure and window. Standard light-frame construction would reduce exterior to interior noise levels by at least 20 dB (Federal Highway Administration 2011). With the installation of windows with a sound transmission class (STC) rating of 25 or higher, interior noise levels within the units in Building 1 would be reduced to 45 CNEL and interior noise levels would be less than significant. Interior noise levels at all other buildings would be 45 CNEL with standard light frame construction and without consideration of specific building components.

On-site Generated Noise

The project site is surrounded by single-family residential uses to the northeast and southeast, multi-family residential uses to the east, a mobile home park to the south, a commercial use to the southwest, and industrial uses to the west and north. The applicable daytime (7:00 a.m. to 10:00 p.m.) and nighttime (10:00 p.m. to 7:00 a.m.) Noise Ordinance limits are 60 dB(A) L_{eq} and 50 dB(A) L_{eq} at the single-family residential uses, 65 dB(A) L_{eq} and 55 dB(A) L_{eq} at the multi-family residential and mobile home park uses, 65 dB(A) L_{eq} and 55 dB(A) L_{eq} at the commercial uses, and 65 dB(A) L_{eq} and 60 dB(A) L_{eq} at the industrial uses. The noise sources on the project site after completion of construction are anticipated to be those that would be typical of any residential use, such as vehicles arriving and leaving, children at play, and landscape maintenance machinery. None of these noise sources are anticipated to violate the Municipal Code. Rooftop heating, ventilating, and air conditioning noise levels were modeled at the property line adjacent properties. As calculated in this analysis, HVAC noise levels would range from 33 to 42 dB(A) L_{eq} at the adjacent properties. Noise levels would not exceed the applicable Noise Ordinance limits at the property lines.


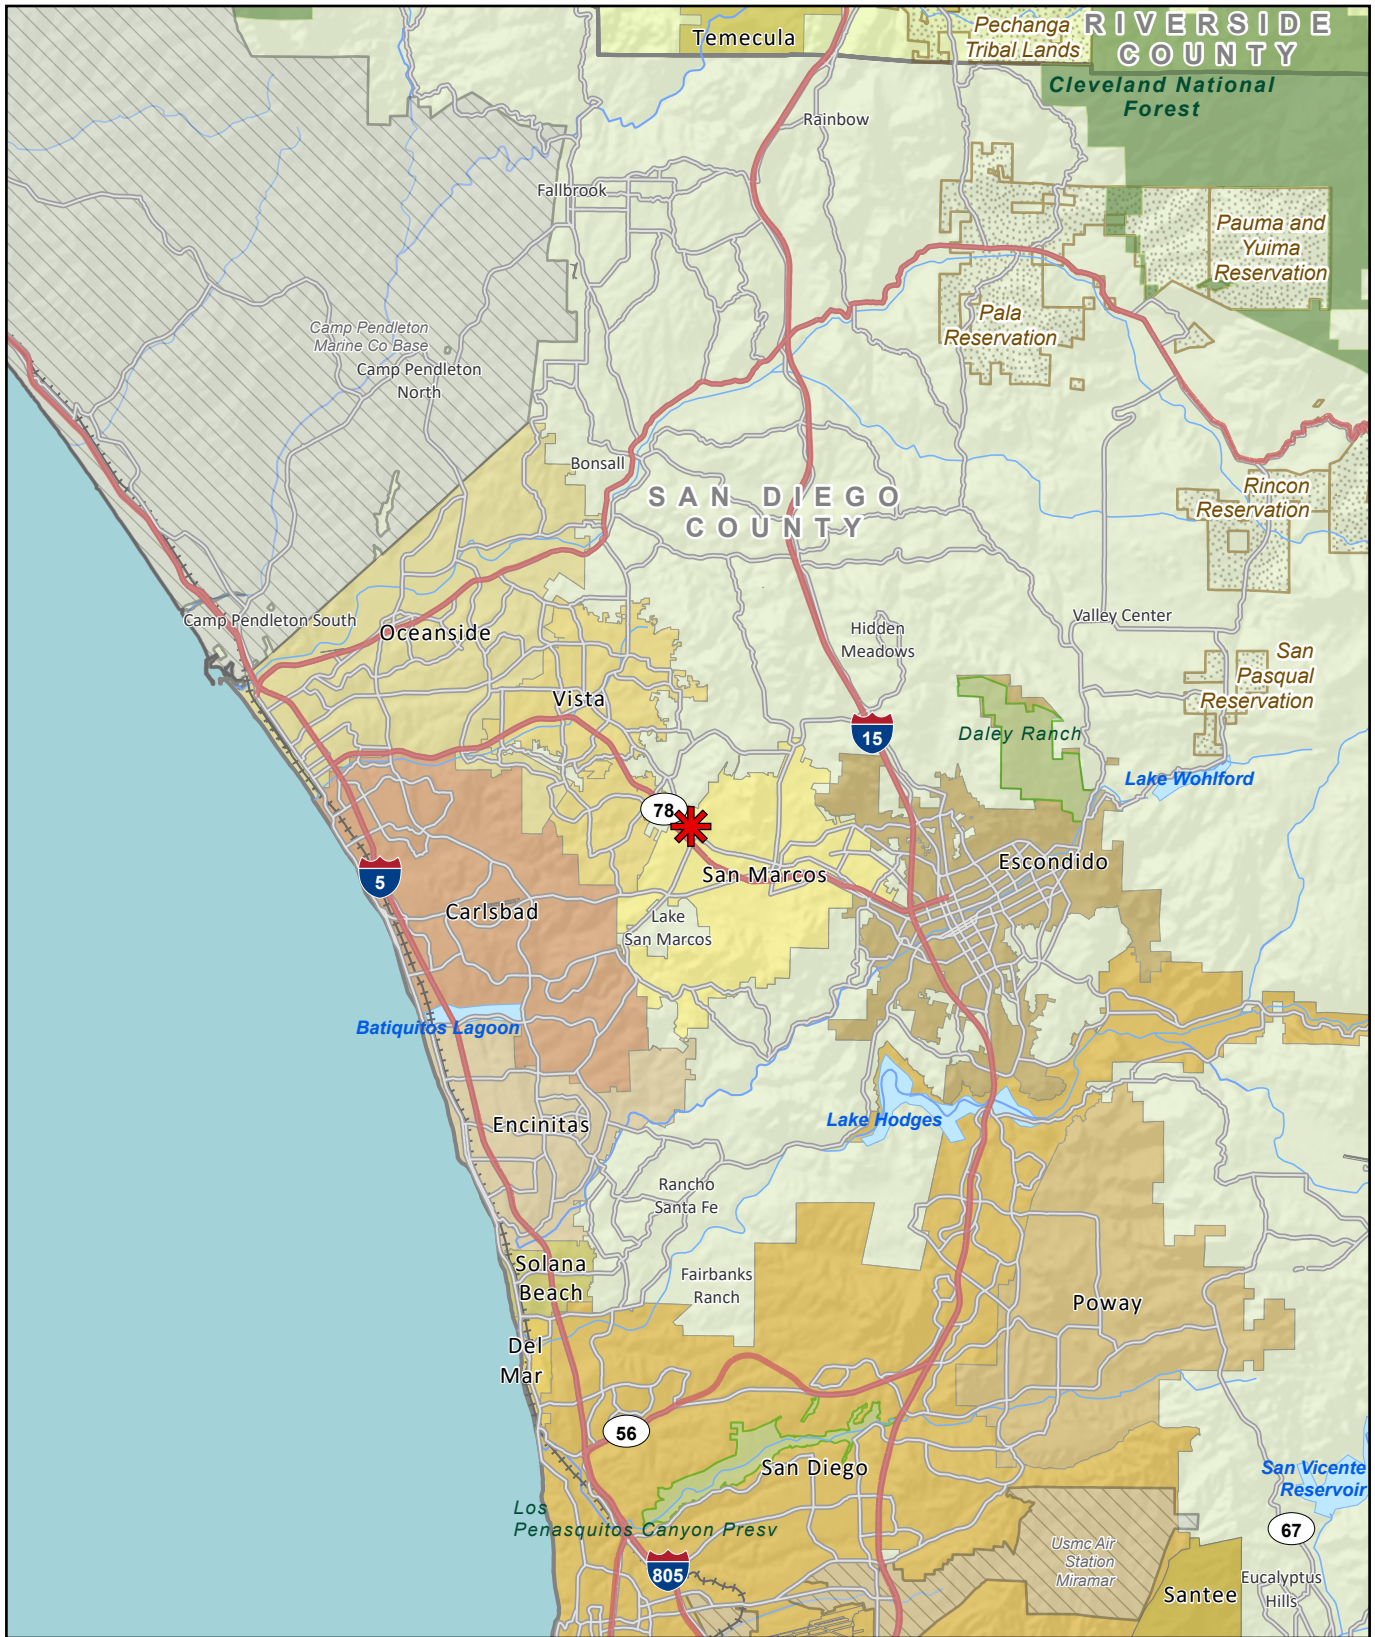
1.0 Introduction

1.1 Project Description


The project is located in the city of San Marcos at 2966, 2972, and 2982 South Santa Fe Avenue adjacent to North Las Flores Drive on assessor parcel numbers (APNs) 217-161-18, 217-161-19, and 0.37 acres of APN 217-161-17. The 2.6-acre (net) project site is comprised of APNs 217-161-18, 217-161-19, and 0.37 acres of APN 217-161-17. The project also proposes approximately 0.12 acres of off-site improvements, including the construction of a new shared driveway extending into the southern portion of APN 217-161-17, upgrades to the existing liquor store parking lot, and landscaping within the 8-foot-wide irrevocable offer of dedication area along the project frontage. Figure 1 shows the regional location. Figure 2 shows an aerial photograph of the project site and vicinity.

On February 28, 2023, the City of San Marcos City Council adopted a Mitigated Negative Declaration (MND; ND22-008; SCH No. 2022090486), approved a GPA (GPA21-0008), approved a Rezone (21-0004), and approved a Multi-Family Site Development Plan (MFSDP21-0002) for the Santa Fe Flores, LP Project (approved project). The requested Rezone (R21-0004) required a second reading prior to approval on March 14, 2023. The approved project evaluated the impacts associated with a GPA to change the land use from Commercial (C) and Light Industrial (L-I) to Medium Density Residential 2 (MDR2) and a zone change from Commercial (C) and Light Industrial (L-I) to Multi-Family Residential (R-3-10) to allow for the construction of 50 multi-family residential townhome units, in conjunction with a Density Bonus, on a 2.23-acre site consisting of two parcels, APNs 217-161-18 and 217-161-19.

Subsequent to MND approval, the applicant modified the site plan and added 0.37 acres of APN 217-161-17 through a lot line adjustment to be processed. The project would require a GPA from Medium Density Residential 2 (MDR2) to Medium High Density Residential (MHDR) for APNs 217-161-18 and 217-161-19, and a GPA from Commercial (C) to Medium High Density Residential (MHDR) for 0.37 acres of the northern portion of APN 217-161-17. Additionally, the project would rezone APNs 217-161-18 and 217-161-19 from Multi-Family Residential 3 (R-3-10) to Multi-Family Residential (R-3-6) and 0.37 acres of the northern portion of APN 217-161-17 from Commercial (C) to Multi-Family Residential (R-3-6). The project would develop 46 multi-family residential townhome units in seven buildings that would be three stories in height. Vehicle parking would include 92 spaces within attached garages and 15 guest spaces. The liquor store would not be part of the project and would remain. Project grading would include 23,300 cubic yards of cut and 3,200 cubic yards of fill resulting in the export of 20,100 cubic yards of soil. Figure 3 shows the proposed site plan.



 Project Location





-  Project Boundary
-  Off-site Improvements

FIGURE 2
Project Location on Aerial Photograph


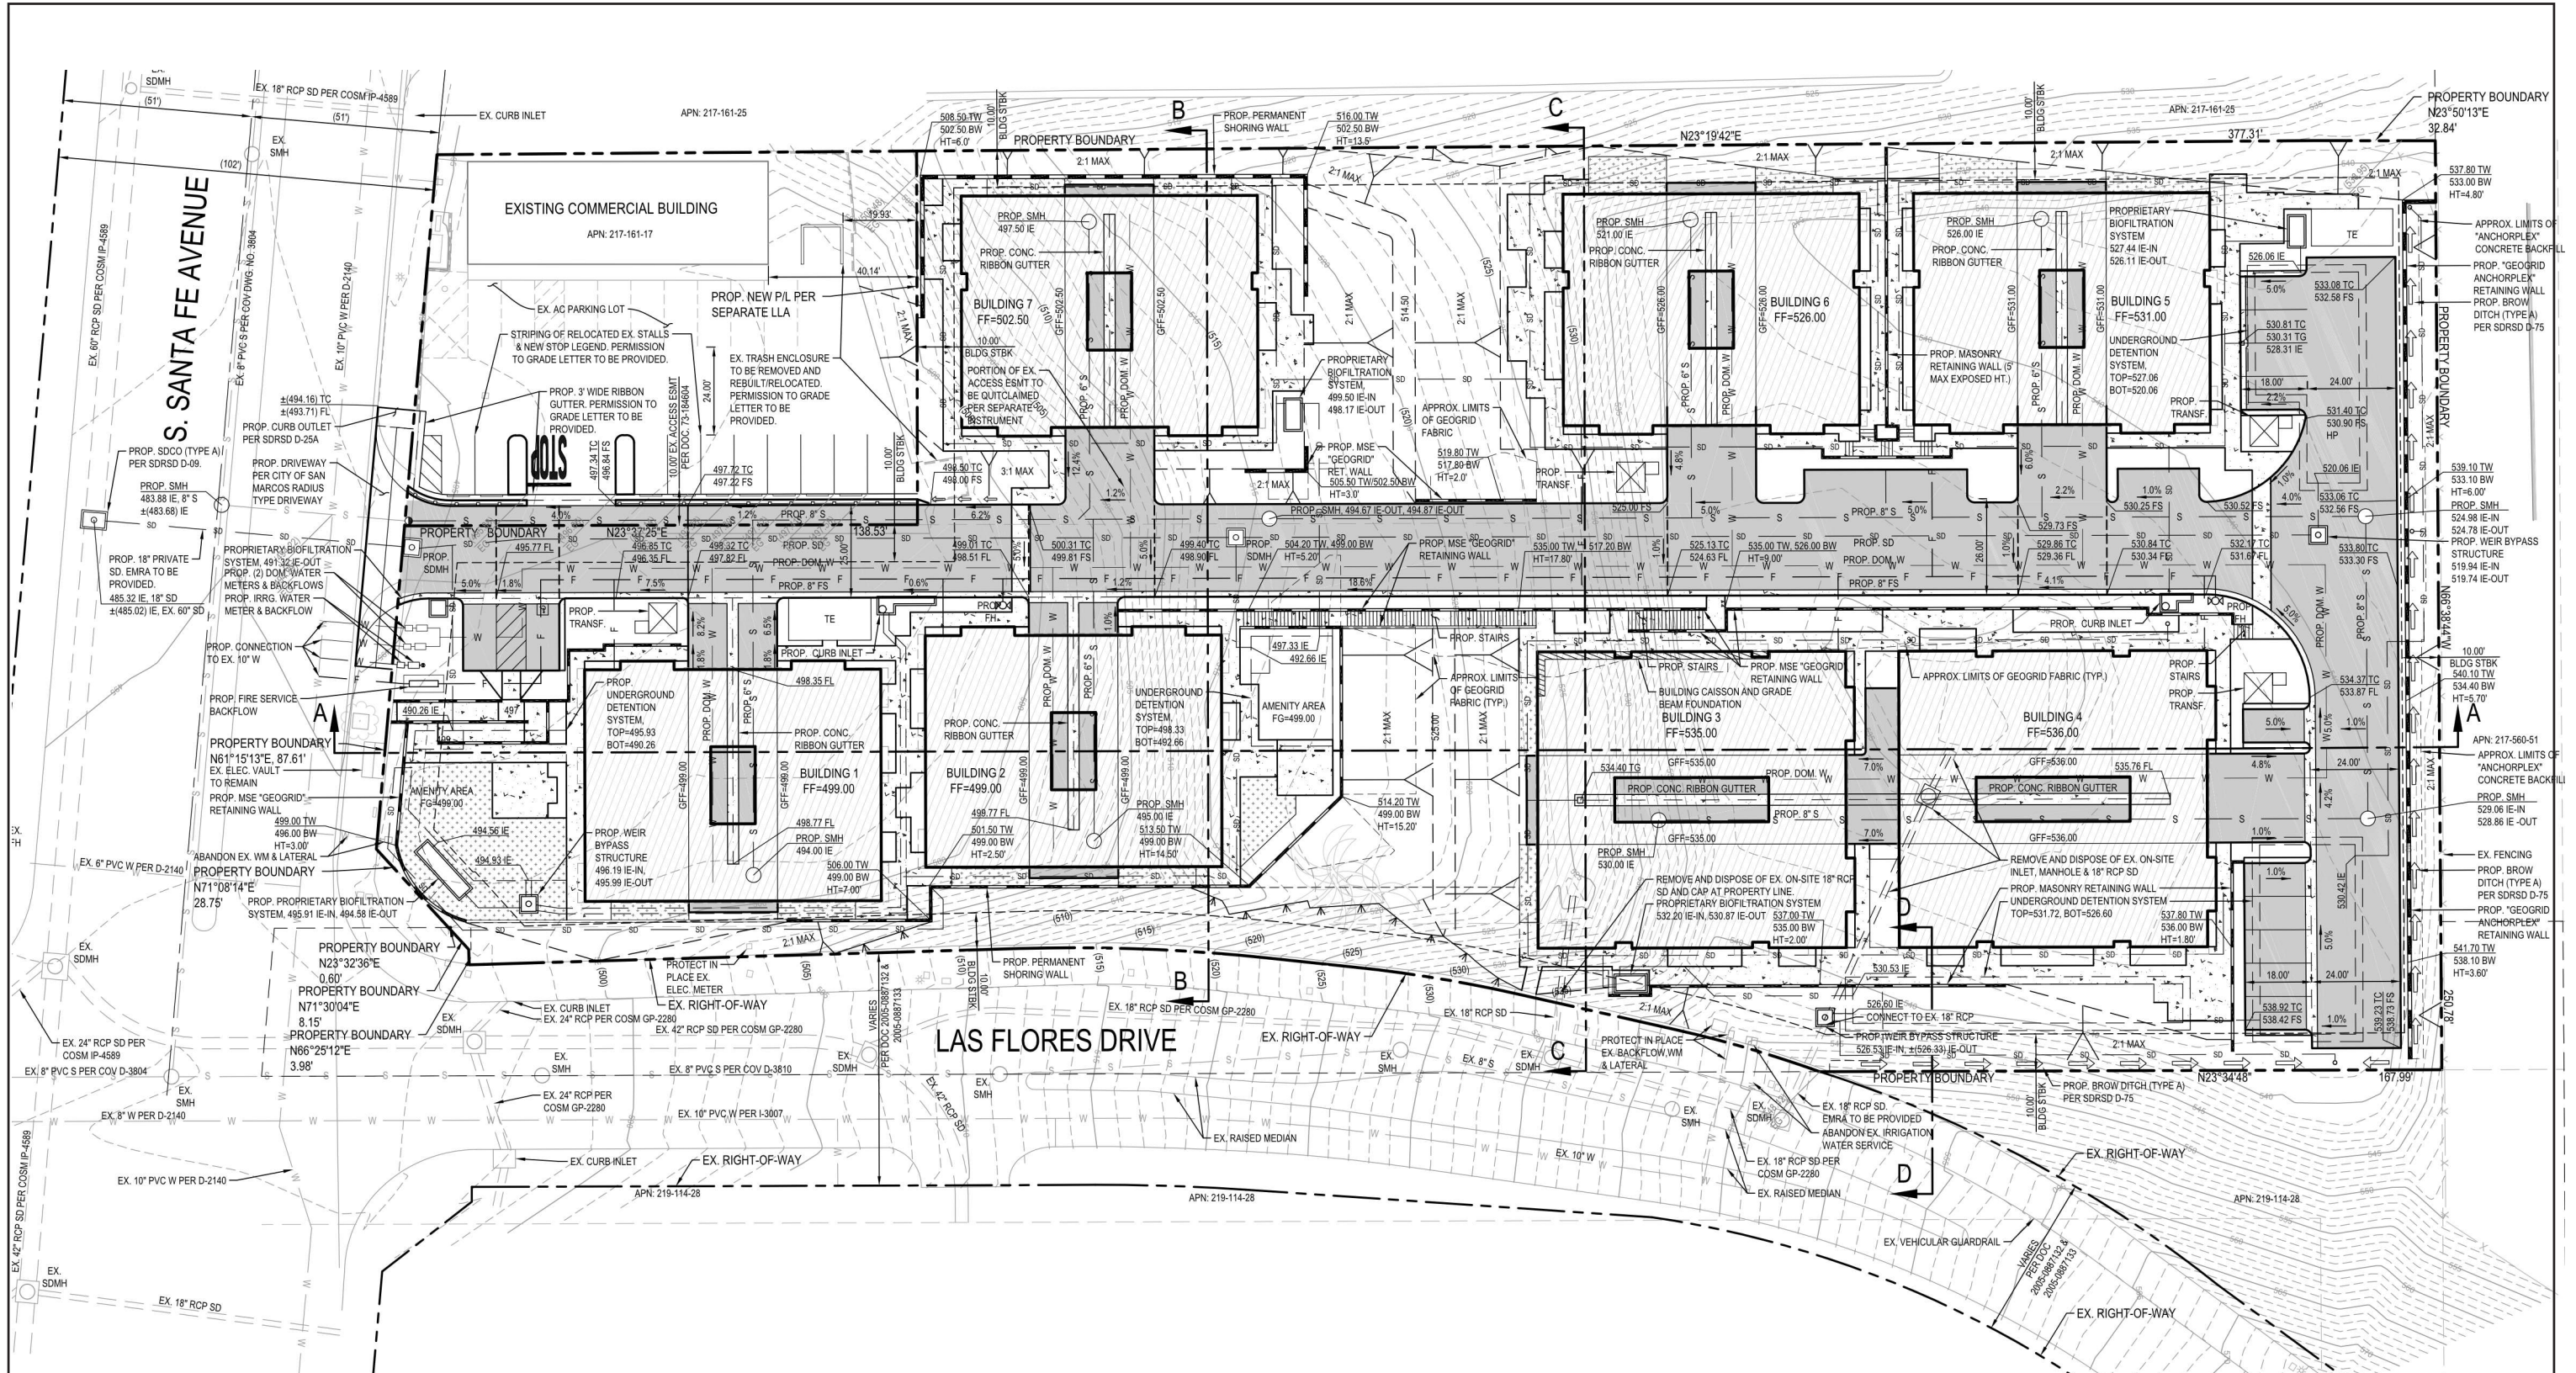


FIGURE 3
Site Plan

1.2 Fundamentals of Noise

Sound levels are described in units called the decibel (dB). Decibels are measured on a logarithmic scale that quantifies sound intensity in a manner similar to the Richter scale used for earthquake magnitudes. Thus, a doubling of the energy of a noise source, such as doubling of traffic volume, would increase the noise level by 3 dB; a halving of the energy would result in a 3 dB decrease. However, human perception of noise has no simple correlation with acoustical energy. A change in noise levels is generally perceived as follows: 3 A-weighted dB (dB(A)) barely perceptible, 5 dB(A) readily perceptible, and 10 dB(A) perceived as a doubling or halving of noise (California Department of Transportation [Caltrans] 2013).

In technical terms, sound levels are described as either a “sound power level” or a “sound pressure level,” which while commonly confused, are two distinct characteristics of sound. Both share the same unit of measure, the dB. However, sound power, expressed as L_{pw} , is the energy converted into sound by the source. As sound energy travels through the air, it creates a sound wave that exerts pressure on receivers such as an eardrum or microphone, the sound pressure level. Sound measurement instruments only measure sound pressure, and limits used in standards are generally sound pressure levels.

The human ear is not equally sensitive to all frequencies within the sound spectrum. To accommodate this phenomenon, the A-scale, which approximates the frequency response of the average young ear when listening to most ordinary everyday sounds, was devised. When people make relative judgments of the loudness or annoyance of a sound, their judgments correlate well with the A-scale sound levels of those sounds. Therefore, the “A-weighted” noise scale is used for measurements and standards involving the human perception of noise. Noise levels using A-weighted measurements are designated with the notation dB(A).

1.2.1 Descriptors

The impact of noise is not a function of loudness alone. The time of day when noise occurs and the duration of the noise are also important. In addition, most noise that lasts for more than a few seconds is variable in its intensity. Consequently, a variety of noise descriptors has been developed. The noise descriptors used for this study are the equivalent noise level (L_{eq}) and the community noise equivalent level (CNEL). The L_{eq} is the equivalent steady-state noise level in a stated period of time that is calculated by averaging the acoustic energy over a time period; when no period is specified, a 1-hour period is assumed.

The CNEL is a 24-hour equivalent sound level. The CNEL calculation applies an additional 5 dB(A) penalty to noise occurring during evening hours, between 7:00 p.m. and 10:00 p.m., and a 10 dB(A) penalty is added to noise occurring during the night, between 10:00 p.m. and 7:00 a.m. These increases for certain times are intended to account for the added sensitivity of humans to noise during the evening and night.

1.2.2 Propagation

Sound from a localized source (approximating a “point” source) radiates uniformly outward as it travels away from the source in a spherical pattern, known as geometric spreading. The sound level decreases or drops off at a rate of 6 dB(A) for each doubling of the distance (e.g., a noise level of 60 dB(A) at 50 feet from a point source would attenuate to 54 dB(A) at 100 feet).

Traffic noise is not a single, stationary point source of sound. The movement of vehicles makes the source of the sound appear to emanate from a line (line source) rather than a point when viewed over some time interval. The drop-off rate for a line source is 3 dB(A) for each doubling of distance (e.g., a noise level of 60 dB(A) at 50 feet from a line source would attenuate to 57 dB(A) at 100 feet).

The propagation of noise is also affected by the intervening ground, known as ground absorption. A hard site (such as parking lots or smooth bodies of water) receives no additional ground attenuation, and the changes in noise levels with distance (drop-off rate) are simply the geometric spreading of the source. A soft site (such as soft dirt, grass, or scattered bushes and trees) provides an additional ground attenuation value of 1.5 dB(A) per doubling of distance. For example, under soft site conditions, a noise level of 60 dB(A) at 50 feet from a point source would attenuate to 52.5 dB(A) at 100 feet, and a noise level of 60 dB(A) at 50 feet from a line source would attenuate to 55.5 dB(A) at 100 feet.

2.0 Applicable Noise Standards

2.1 General Plan

The Noise Element of the City General Plan provides land use compatibility guidelines to ensure that new developments are sited, designed, and constructed in such a manner that ambient noise levels would not create an unacceptable noise environment for the occupants and patrons of the new development. Table 1 provides the interior and exterior noise guidelines for various types of uses and developments.

The project proposes multi-family residential uses. As shown in Table 1, the applicable standards for multi-family uses are an exterior noise level of 65 CNEL and an interior noise level of 45 CNEL. The exterior noise level standard is applicable at the proposed exterior use areas. For the proposed project, this includes second- and third-floor balconies, rooftop decks, and the five proposed amenity areas consisting of active play areas and passive gathering areas.

Table 1 Interior and Exterior Noise Guidelines		
Land Use	Maximum Noise Level (CNEL)	
	Interior ¹	Exterior ^{2,3}
Residential – single-family, mobile homes, or age-restricted housing	45	60
Residential – multi-family residences or mixed use	45	65
Lodging – hotels, motels	45	65
Schools, churches, hospitals, residential care facility, child-care facilities	50	65
Passive recreational parks, nature preserves, contemplative spaces, cemeteries	--	65
Active parks, golf courses, athletic fields, outdoor spectator sports, water recreation	--	65
Office/professional, government, medical/dental, commercial, retail, laboratories	50	65
Industrial, manufacturing, utilities, agriculture, mining, stables, ranching, warehouse, maintenance/repair	--	65
CNEL = community noise equivalent level SOURCE: City of San Marcos General Plan Update, Noise Element 2012. ¹ Applies only to interior habitable rooms. ² Exterior noise standard does not apply for land uses where no exterior use area is proposed or necessary, such as a library. ³ For single-family detached dwelling units, “exterior noise level” is defined as the noise level measured at an outdoor living area that adjoins and is on the same lot as the dwelling.		

2.2 Municipal Code

2.2.1 Title 10, Chapter 10.24 – Construction

Section 10.24.020 (b)(9) of the City Municipal Code identifies permissible hours for general construction activities. Excluding City holidays, construction may occur weekdays from 7:00 a.m. to 6:00 p.m. or Saturdays from 8:00 a.m. to 5:00 p.m. Grading is often the loudest phase of construction. Section 17.32.180 restricts grading and earthworks activities to between the hours of 7:00 a.m. and 4:30 p.m., Monday through Friday.

2.2.2 Title 20 – Zoning Ordinance

City Municipal Code Title 20 – Zoning Ordinance contains General Development Standards. Performance standards in Section 20.300.070 (f) set restrictions on noise levels by zoning. No person shall create or allow the creation of exterior noise that causes the noise level to exceed the noise standards shown in Table 2.

Table 2 Municipal Code Property Line Noise Standards		
Zone	Time	Allowable Property Line Noise Level [dB(A) L _{eq}]
Single-Family Residential (A, R-1, R-2)	7:00 a.m. to 10:00 p.m.	60
	10:00 p.m. to 7:00 a.m.	50
Multi-Family Residential (R-3)	7:00 a.m. to 10:00 p.m.	65
	10:00 p.m. to 7:00 a.m.	55
Commercial (C, O-P, SR)	7:00 a.m. to 10:00 p.m.	65
	10:00 p.m. to 7:00 a.m.	55
Industrial	7:00 a.m. to 10:00 p.m.	65
	10:00 p.m. to 7:00 a.m.	60

dB(A) L_{eq} = A-weighted decibels equivalent noise level
 SOURCE: Section 20.300.070(f) Table 20.300-4, San Marcos Municipal Code Title 20 – Zoning Code.

The project site is surrounded by single-family residential uses to the northeast and southeast, multi-family residential uses to the east, a mobile home park to the south, a commercial use to the southwest, and industrial uses to the west and north.

2.3 California Green Building Standards Code – Environmental Comfort

Interior noise levels for habitable rooms are regulated also by Title 24 of the California Code of Regulations (CCR) California Noise Insulation Standards. Title 24, Chapter 12, Section 1206.4, of the 2019 California Building Code requires that interior noise levels attributable to exterior sources not exceed 45 CNEL in any habitable room. A habitable room is a room used for living, sleeping, eating, or cooking. Bathrooms, closets, hallways, utility spaces, and similar areas are not considered habitable rooms for this regulation (24 CCR, Chapter 12, Section 1206.4).

3.0 Existing Conditions

Existing noise levels in the vicinity of the project site were measured on March 22, 2022, using one Larson-Davis Model LxT, Type 1 Integrating Sound Level Meter, serial number 3895. The following parameters were used:

Filter:	A-weighted
Response:	Slow
Interval Period	1 minute
Time History Period:	5 seconds

The meter was calibrated before and after each measurement. The meter was set 5 feet above the ground level for each measurement.

Noise measurements were taken to obtain typical ambient noise levels at the project site and in the vicinity. The weather was sunny and warm. Two 15-minute measurements were taken, as described

below. The measurement locations are shown on Figure 4, and detailed data is contained in Attachment 1.

Measurement 1 was located near the southern project boundary, 50 feet north of South Santa Fe Avenue. Noise levels were measured for 15 minutes. The main noise source at this location was vehicle traffic on South Santa Fe Avenue. Vehicle traffic on South Santa Fe Avenue was counted during the measurement period. The average measured noise level was 63.2 dB(A) L_{eq} .

Measurement 2 was located near the eastern project boundary, approximately 50 feet west of North Las Flores Drive. Noise levels were measured for 15 minutes. The main noise source at this location was vehicle traffic on North Las Flores Drive. Secondary sources of noise included vehicle traffic on South Santa Fe Avenue. Vehicle traffic on North Las Flores Drive was counted during the measurement period. The average measured noise level was 57.5dB(A) L_{eq} .




Noise measurements are summarized in Table 3. Traffic counts conducted during Measurements 1 and 2 are summarized in Table 4.

Table 3 Noise Measurements				
Measurement	Location	Time	Main Noise Source	L_{eq}
1	50 Feet North of South Santa Fe Avenue	1:34 p.m. – 1:49 p.m.	Vehicle Traffic on South Santa Fe Avenue	63.2
2	50 feet west of North Las Flores Drive	1:55 p.m. – 2:10 p.m.	Vehicle traffic on North Las Flores Drive	57.5

L_{90} = Noise level exceeded 90 percent of the time.
NOTE: Noise measurement data is contained in Attachment 1.

Table 4 15-minute Traffic Counts							
Measurement	Roadway	Direction	Autos	Medium Trucks	Heavy Trucks	Buses	Motorcycles
1	South Santa Fe Avenue	Eastbound	78	8	0	5	0
		Westbound	71	4	1	2	0
2	North Las Flores Drive	Northbound	13	0	0	0	0
		Southbound	11	0	0	0	0



-  Project Boundary
-  Off-site Improvements
-  Noise Measurement Location




FIGURE 4
Noise Measurement Locations

4.0 Analysis Methodology

Noise level predictions and contour mapping were developed using noise modeling software, SoundPlan Essential, version 4.1 (Navcon Engineering 2018). SoundPLAN calculates noise propagation based on the International Organization for Standardization method (ISO 9613-2 – Acoustics, Attenuation of Sound during Propagation Outdoors). The model calculates noise levels at selected receiver locations using input parameter estimates such as total noise generated by each noise source; distances between sources, barriers, and receivers; and shielding provided by intervening terrain, barriers, and structures. The model outputs can be developed as noise level contour maps or noise levels at specific receivers. In all cases, receivers were modeled at 5 feet above ground elevation, which represents the average height of the human ear.

4.1 Construction Noise Analysis

Project construction noise would be generated by diesel engine-driven construction equipment used for site preparation and grading, building construction, loading, unloading, and placing materials and paving. Diesel engine-driven trucks also would bring materials to the site and remove the soils from excavation.

Construction equipment with a diesel engine typically generates maximum noise levels from 70 to 95 dB(A) L_{eq} at a distance of 50 feet (Federal Highway Administration [FHWA] 2006 and 2008, Federal Transit Authority 2018). During construction, equipment moves to different locations and goes through varying load cycles, and there are breaks for the operators and for non-equipment tasks, such as measurement. Table 5 summarizes typical construction equipment noise levels and duty cycles.

Equipment	Noise Level at 50 Feet (dB(A) L_{eq})	Typical Duty Cycle
Auger Drill Rig	85	20%
Backhoe	80	40%
Blasting	94	1%
Chain Saw	85	20%
Clam Shovel	93	20%
Compactor (ground)	80	20%
Compressor (air)	80	40%
Concrete Mixer Truck	85	40%
Concrete Pump	82	20%
Concrete Saw	90	20%
Crane (mobile or stationary)	85	20%
Dozer	85	40%
Dump Truck	84	40%
Excavator	85	40%
Front End Loader	80	40%
Generator (25 kilovolt amps or less)	70	50%
Generator (more than 25 kilovolt amps)	82	50%

Table 5 Typical Construction Equipment Noise Levels		
Equipment	Noise Level at 50 Feet (dB(A) L_{eq})	Typical Duty Cycle
Grader	85	40%
Hydra Break Ram	90	10%
Impact Pile Driver (diesel or drop)	95	20%
In situ Soil Sampling Rig	84	20%
Jackhammer	85	20%
Mounted Impact Hammer (hoe ram)	90	20%
Paver	85	50%
Pneumatic Tools	85	50%
Pumps	77	50%
Rock Drill	85	20%
Roller	74	40%
Scraper	85	40%
Tractor	84	40%
Vacuum Excavator (vac-truck)	85	40%
Vibratory Concrete Mixer	80	20%
Vibratory Pile Driver	95	20%
dB(A) L_{eq} = A-weighted decibels average noise level SOURCE: Federal Highway Administration 2006 and 2008; Federal Transit Authority 2018.		

Construction equipment would generate maximum noise levels between 70 and 95 dB(A) maximum noise level (L_{max}) at 50 feet from the source when in operation. During excavation, grading, and paving operations, equipment moves to different locations and goes through varying load cycles, and there are breaks for the operators and for non-equipment tasks, such as measurement. Average construction noise levels were calculated for the simultaneous operation of three common pieces of construction equipment: dozer, excavator, and loader. FTA guidance recommends analyzing the two noisiest pieces of construction equipment (FTA 2018), therefore this is a conservative assessment. The usage factors were applied to the maximum noise level at 50 feet for each piece of equipment, and then noise levels were added logarithmically. Hourly average noise levels would be approximately 85 dB(A) L_{eq} at 50 feet from the center of construction activity when assessing three pieces of common construction equipment working simultaneously.

4.2 Traffic Noise Analysis

4.2.1 On-site Traffic and Rail Noise

The SoundPLAN program uses the FHWA Traffic Noise Model algorithms and reference levels to calculate noise levels at selected receiver locations. The model uses various input parameters, such as projected hourly average traffic rates; vehicle mix, distribution, and speed; roadway lengths and gradients; distances between sources, barriers, and receivers; and shielding provided by intervening terrain, barriers, and structures. Receivers, roadways, and barriers were input into the model using three-dimensional coordinates. The locations of future buildings were obtained from project plans and drawings.

The main source of traffic noise at the project site is vehicle traffic on South Santa Fe Avenue and North Las Flores Drive as well as Sprinters on the adjacent rail line. Future year 2050 with project traffic volumes for South Santa Fe Avenue were obtained from the Traffic Impact Analysis prepared for the project (Linscott, Law & Greenspan, Engineers [LLG] 2026). Future year 2050 traffic volumes for North Las Flores Drive were obtained from San Diego Association of Governments (SANDAG) traffic projections (SANDAG 2025). A vehicle classification mix of 93.0 percent automobiles, 3.0 percent medium trucks, 2.0 percent heavy trucks, 1.0 percent buses, and 1.0 percent motorcycles were modeled. Based on the field traffic counts, this classification mix is conservative.

Table 6 summarizes the traffic volumes and vehicle classification mixes for the modeled roadways.

Table 6 Modeled Vehicle Traffic Parameters								
Roadway	Segment	Year 2050 Average Daily Traffic	Speed	Vehicle Mix (percent)				
				Autos	Medium Trucks	Heavy Trucks	Buses	Motorcycles
South Santa Fe Avenue	Community Drive to North Las Flores Drive	22,570	45	93	3	2	1	1
	North Las Flores Drive to North Rancho Santa Fe Road	21,480	45	93	3	2	1	1
Las Flores Drive	South of South Santa Fe Avenue	3,400	25	93	3	2	1	1
North Las Flores Drive	North of South Santa Fe Avenue	1,600	25	93	3	2	1	1

The project site is also located approximately 150 feet southwest of the Sprinter rail line. The Sprinter is a light rail commuter train operated by the North County Transit District. The east-west Sprinter rail spans 22 miles from Oceanside to Escondido. The Palomar College Station is the closest Sprinter station to the project site. Fridays experience the largest number of daily Sprinter trains. The number of Friday daytime, evening, and nighttime Sprinter trains was obtained from published schedules and is summarized in Table 7.

Table 7 Modeled Sprinter Trains			
Direction	Daytime	Evening	Nighttime
	7:00 a.m. – 7:00 p.m.	7:00 p.m. – 10:00 p.m.	10:00 p.m. – 7:00 a.m.
Eastbound	24	6	10
Westbound	24	6	8
TOTAL	48	12	18

4.2.2 Off-site Traffic Noise

Off-site traffic noise was modeled using the FHWA Traffic Noise Prediction Model algorithms and reference levels. Traffic noise levels were calculated at 50 feet from the centerline of the affected roadways to determine the noise level increase associated with the project. The model uses various input parameters, such as traffic volumes, vehicle mix, distribution, and speed.

The roadways included in the traffic impact analysis are South Santa Fe Avenue, Hollencrest Road, and North Rancho Santa Fe Road. Traffic noise levels were calculated based on the total average daily traffic volumes on each roadway segment. For modeling purposes, “hard” ground conditions were used for the analysis of future conditions, since a majority of the project area is paved and the hard site provides the most conservative impact assessment.

Existing (year 2022), near term (year 2027), and future (year 2050) traffic volumes with and without the project were obtained from the project traffic impact analysis (LLG 2026). Table 8 summarizes the future traffic volumes for the area roadway segments. Modeled noise levels do not account for shielding provided by intervening barriers and structures.

Table 8 Future Vehicle Traffic Parameters							
Roadway Segment	Average Daily Traffic						Speed (mph)
	Existing	Existing + Project	Year 2027	Year 2027 + Project	Year 2050	Year 2050 + Project	
South Santa Fe Avenue							
Similax Road to Bosstick Boulevard	14,850	14,960	16,110	16,220	22,200	22,310	45
Bosstick Boulevard to Community Drive	16,660	16,770	18,080	18,190	22,200	22,310	45
Community Drive to North Las Flores Drive	16,660	17,030	18,080	18,450	22,200	22,570	45
North Las Flores Drive to North Rancho Santa Fe Road	14,600	14,780	15,840	16,020	21,300	21,480	45
North Rancho Santa Fe Road to North Pacific Street	13,500	13,570	14,650	14,720	24,400	24,470	40
Hollencrest Road							
De Leone Road to Hollenbeck Road	560	600	610	650	830	870	25
North Rancho Santa Fe Avenue							
South Santa Fe Avenue to Capalina Road	11,730	11,840	12,730	12,840	16,800	16,910	40
mph = miles per hour							
SOURCE: Linscott, Law & Greenspan, Engineers, Inc. 2026.							

4.3 On-site Generated Noise Analysis

On-site noise sources on the project site after completion of construction are anticipated to be those that would be typical of any multi-family use, such as vehicles arriving and leaving, children at play, and landscape maintenance machinery. None of these noise sources are anticipated to violate the City Municipal Code or result in a substantial permanent increase in existing noise levels. However, the project would include rooftop heating, ventilation, and air conditioning (HVAC) equipment. Noise levels due to HVAC equipment were modeled and compared to City limits (see Table 2).

The HVAC equipment would be located on the roof with screened walls. It is not known at this time which manufacturer, brand, or model of unit or units will be selected for use in the project. For the purposes of this analysis, to determine what general noise levels the HVAC units would generate, it was assumed that the rooftop units would be similar to a Carrier unit with a sound power level of 75 dB(A). Noise specifications are contained in Attachment 2. All units were modeled at full capacity during the daytime and nighttime hours.

Noise levels due to on-site sources were modeled using SoundPLAN. The SoundPLAN program models noise propagation following the International Organization for Standardization method *ISO 9613-2 – Acoustics, Attenuation of Sound during Propagation Outdoors*. The model calculates noise levels at selected receiver locations using input parameter estimates such as total noise generated by each noise source; distances between sources, barriers, and receivers; and shielding provided by intervening structures.

5.0 Future Acoustical Environment and Impacts

5.1 Construction Noise

Noise associated with the grading, building, and paving for the project would potentially result in short-term impacts to surrounding residential properties. There are residential uses located northeast, east, southeast, and south of the project site. A variety of noise-generating equipment would be used during the construction phase of the project, such as excavators, backhoes, front-end loaders, and concrete saws, along with others. The exact number and pieces of construction equipment required are not known at this time. As discussed, average construction noise levels were calculated. Based on this analysis, hourly average noise levels would be approximately 85 dB(A) L_{eq} at 50 feet from the center of construction activity when assessing three pieces of common construction equipment working simultaneously. Construction noise is considered a point source and would attenuate at approximately 6 dB(A) for every doubling of distance. To reflect the nature of grading and construction activities, equipment was modeled as an area source distributed over the project footprint. Noise levels were modeled at a series of 18 receivers located at the adjacent uses. The results are summarized in Table 9. Modeled receiver locations and construction noise contours are shown in Figure 5. SoundPLAN data is contained in Attachment 3.

Receiver	Land Use	Noise Level [dB(A) L_{eq}]
1	Single-Family Residential	58
2	Single-Family Residential	60
3	Single-Family Residential	61
4	Single-Family Residential	60
5	Single-Family Residential	59
6	Multi-Family Residential	56
7	Multi-Family Residential	58
8	Multi-Family Residential	68
9	Multi-Family Residential	70
10	Single-Family Residential	63
11	Mobile Home Park	66
12	Mobile Home Park	65
13	Mobile Home Park	61
14	Mobile Home Park	59
15	Industrial	68
16	Industrial	66
17	Industrial	73
18	Commercial	73

dB(A) L_{eq} = A-weighted decibels equivalent noise level

As shown, construction noise levels would range from 56 to 73 dB(A) L_{eq} at the adjacent uses. The City's Municipal Code does not place noise limit restrictions on construction activities; however, other jurisdictions commonly apply a noise level limit of 75 dB(A) L_{eq} at residential uses. Construction noise levels would not exceed 75 dB(A) L_{eq} . Construction activities would generally occur over the period between 7:00 a.m. and 6:00 p.m. on weekdays. Although the existing adjacent uses would be exposed to construction noise levels that may be heard above ambient conditions, the exposure would be temporary and would not exceed 75 dB(A) L_{eq} . As construction activities associated with the project would comply with the time limits established in Section 10.24.020 (b)(9) of the City Municipal Code, temporary increases in noise levels from construction activities would be less than significant.

5.2 Traffic Noise

5.2.1 On-site Traffic and Rail Noise

On-site traffic and rail noise contours were developed using the SoundPLAN program. Noise level contours were modeled at the first-floor level. These contours take into account shielding provided by the proposed buildings and grading. Future vehicle and rail traffic noise-level contours are shown in Figure 6. SoundPLAN data are contained in Attachment 4.

As discussed in Section 2.1, the exterior noise level standard for multi-family uses is 65 CNEL. This standard is applicable at exterior use areas which include second- and third-floor balconies, rooftop decks, and the five proposed amenity areas consisting of active play areas and passive gathering areas. The interior noise level standard is 45 CNEL. To refine the noise analysis and determine noise levels at exterior use areas and the building façade, exterior noise levels were calculated at a series of first- through third-floor specific receiver locations at the outdoor use areas and around the proposed building. Modeled receiver locations are shown in Figure 6. Table 10 summarizes the projected future noise levels at the 26 modeled receivers. Modeled noise levels shown in Table 10 do not include noise reduction provided by any noise barriers.



- Project Boundary
- Off-site Improvements
- Receivers

Construction Noise

- 60 dB(A) L_{eq}
- 65 dB(A) L_{eq}
- 70 dB(A) L_{eq}
- 75 dB(A) L_{eq}













FIGURE 5
Construction Noise Contours



-  Project Boundary
-  Off-site Improvements
-  Receivers
-  Site Plan
-  Amenity Area A 6-foot Barrier
-  Buildings

Vehicle and Rail Noise

-  50 CNEL
-  55 CNEL
-  60 CNEL
-  65 CNEL




FIGURE 6
Future Vehicle and Rail Noise Contours

Table 10 Future Vehicle and Rail Traffic Noise Levels				
Receiver	Location	Exterior Noise Level (CNEL)		
		First-Floor	Second-Floor	Third-Floor
1	Amenity Area A	68	--	--
2	Amenity Area B	46	--	--
3	Amenity Area C	50	--	--
4	Amenity Area D	46	--	--
5	Amenity Area E	54	--	--
6	Amenity Area E	42	--	--
7	Building 1	61	63	65
8	Building 1	67	69	70
9	Building 1	63	65	66
10	Building 1 and 2	49	53	55
11	Building 2	57	61	61
12	Building 2	46	50	52
13	Building 2	54	58	60
14	Building 3	54	55	56
15	Building 3	58	60	61
16	Building 3	57	60	60
17	Building 3 and 4	45	49	51
18	Building 4	51	55	59
19	Building 4	48	51	52
20	Building 4	46	51	52
21	Building 5	46	50	51
22	Building 5	45	49	50
23	Building 5	48	54	56
24	Building 5 and 6	43	49	50
25	Building 6	51	56	57
26	Building 6	55	58	59
27	Building 6	49	53	55
28	Building 7	43	45	49
29	Building 7	47	56	60
30	Building 7	59	63	65
31	Building 7	54	56	58

CNEL = community noise equivalent level
Bold = Exceeds 65 CNEL

As shown, exterior noise levels are projected to range from 42 to 70 CNEL at the building façades and amenity areas. Noise levels would be compatible with the City’s exterior multi-family noise level standard of 65 CNEL at all locations except the amenity area on the south side of Building 1 (Amenity Area A, Receiver 1) and the south and east sides of Building 1 facing the roadways (Receivers 8 and 9). There are second-floor balconies on the south side of Building 1 and third-floor balconies on the east side of Building 1 and a rooftop deck. These balconies and rooftop deck could be exposed to noise levels that exceed 65 CNEL. Based upon these findings, noise control recommendations are necessary at the amenity area south of Building 1, at the balconies on the south and east sides of Building 1, and on the south and east sides of the Building 1 roof deck in order to comply with the City’s noise standard of 65 CNEL. A 6-foot barrier adjacent to the amenity area as shown in Figure 6 was modeled using SoundPLAN and would be necessary to reduce noise levels to 65 CNEL or less

at this active play area. Modeling data is provided in Attachment 4. To determine the required barrier heights at the Building 1 balconies and roof deck, the Fresnel barrier noise reductions were modeled. The balcony and roof deck barriers were modeled using this equation-based method rather than SoundPLAN because of the geometry of these barriers when elevated on balconies and the roof deck. These reductions are based on distance, source height, receiver elevation, and barrier height. The Fresnel barrier reduction calculations are provided as Attachment 5. It was calculated that a 3.5-foot balcony barrier would provide a 7.4 dB reduction at the balconies on the south side of Building 1 (Receiver 2), a 5.9 dB reduction at the balconies on the east side of Building 1 (Receiver 3), and a 7.0 dB reduction on the roof deck. In order to reduce noise levels at these locations, the project would include a 3.5-foot balcony railing as a solid barrier. With construction of these barriers, exterior noise levels would be reduced to less than 65 CNEL.

The interior noise level standard is 45 CNEL. Interior noise levels can be reduced through standard construction techniques. When windows are closed, standard construction techniques provide various exterior-to-interior noise level reductions depending on the type of structure and window. Standard light-frame construction would reduce exterior to interior noise levels by at least 20 dB (FHWA 2011).

As shown in Table 10, noise levels would be as high as 70 CNEL at the south side of Building 1 and 66 CNEL at the east side of Building 1. While the proposed 3.5-foot balcony barriers would reduce noise levels to 65 CNEL at a seated receiver, the entire building façade would not get the same noise attenuation, and the evaluation of specific building components is required. The sound transmission class (STC) rating of windows, walls, and roofs is an integer value that rates how well a building component attenuates noise. The STC rating generally reflects the decibel reduction that a building component can achieve. Standard walls and roofs typically have STC ratings greater than 40, while window components have lower ratings; thus, this analysis focuses on the minimum required window STC ratings. Because a noise reduction of up to 25 dB(A) is required to achieve interior noise levels of 45 CNEL or less, window components with an STC rating of 25 or higher are required for units located on the south and east side of Building 1. With the installation of windows with an STC rating of 25 or higher, interior noise levels within the units in Building 1 would be reduced to 45 CNEL and interior noise levels would be less than significant. Interior noise levels at all other buildings would be 45 CNEL with standard light frame construction and without consideration of specific building components.

5.2.2 Off-site Traffic Noise

The project would increase traffic volumes on local roadways. However, the project would not substantially alter the vehicle classifications mix on local or regional roadways, nor would the project alter the speed on an existing roadway or create a new roadway. Thus, the primary factor affecting off-site noise levels would be increased traffic volumes. While changes in noise levels would occur along any roadway where project-related traffic occurs, for noise assessment purposes, noise level increases are assumed to be greatest nearest the project site, as this location would represent the greatest concentration of project-related traffic. Traffic noise increases attributable to the project were assessed against a significance threshold of 3 dB, which is the level at which an increase in noise is considered to be barely perceptible (Caltrans 2013).

Table 11 presents a conservative assessment of traffic noise levels based on the existing, near term (year 2027), and future (year 2050) noise levels without and with the project. Table 11 also summarizes the direct and cumulative traffic noise level increases due to the project. Noise level calculations are contained in Attachment 6.

Table 11 Traffic Noise Level with and without Project and Ambient Noise Increases (CNEL)										
Roadway Segment	Existing			Near-Term (Year 2027)			Future (Year 2050)			Cumulative Increase Over Existing
	No Project	Project	Increase	No Project	Project	Increase	No Project	Project	Increase	
South Santa Fe Avenue										
Similax Road to Bosstick Boulevard	71.3	71.3	0.0	71.6	71.7	0.1	73.0	73.1	0.1	1.8
Bosstick Boulevard to Community Drive	71.8	71.8	0.0	72.1	72.2	0.1	73.0	73.1	0.1	1.3
Community Drive to North Las Flores Drive	71.8	71.9	0.1	72.1	72.2	0.1	73.0	73.1	0.1	1.3
North Las Flores Drive to North Rancho Santa Fe Road	71.2	71.3	0.1	71.6	71.6	0.0	72.9	72.9	0.0	1.7
North Rancho Santa Fe Road to North Pacific Street	69.8	69.8	0.0	70.1	70.1	0.0	72.3	72.3	0.0	2.5
Hollencrest Road										
De Leone Road to Hollenbeck Road	52.7	53.0	0.3	53.1	53.4	0.3	54.4	54.6	0.2	1.9
North Rancho Santa Fe Avenue										
South Santa Fe Avenue to Capalina Road	69.1	69.2	0.1	69.5	69.5	0.0	70.7	70.7	0.0	1.6

NOTE: Increase calculations may vary due to independent rounding.

As shown, the project would not result in a direct or cumulative noise increase of more than 3 dB. Therefore, the project would result in less than significant direct and cumulative impacts related to traffic noise.

5.3 On-site Generated Noise

The primary noise sources on-site would be HVAC equipment. Rooftop HVAC equipment that would have the potential to produce noise in excess of City limits (see Table 2). Using the on-site noise source parameters discussed in Section 4.3, noise levels were modeled at a series of 17 receivers located at the adjacent properties. Noise generated by HVAC equipment would occur on an intermittent basis, primarily during the day and evening hours and less frequently during the nighttime hours. For a worst-case analysis, it was assumed that the HVAC units would operate at maximum capacity during the daytime and nighttime hours.

Modeled receivers and the locations of the HVAC units are shown in Figure 7. Modeled data is included in Attachment 7. Future projected noise levels are summarized in Table 12.













-  Project Boundary
 -  Off-site Improvements
 -  Receivers
 -  HVAC
 -  Site Plan
 -  Buildings
- HVAC Noise**
-  30 dB(A) L_{eq}
 -  35 dB(A) L_{eq}
 -  40 dB(A) L_{eq}
 -  45 dB(A) L_{eq}



FIGURE 7
HVAC Noise Contours

As shown, HVAC noise levels would range from 33 to 42 dB(A) Leq. Noise levels would not exceed the applicable Noise Ordinance limits at the property lines and impacts related to on-site generated noise would be less than significant.

Table 12 HVAC Noise Levels at Adjacent Properties			
Receiver	Land Use	Noise Level [dB(A) Leq]	Noise Ordinance Limit Daytime/Nighttime [dB(A) Leq]
1	Single Family Residential	33	60/50
2	Single Family Residential	35	60/50
3	Single Family Residential	36	60/50
4	Single-Family Residential	35	60/50
5	Single-Family Residential	34	60/50
6	Multi-Family Residential	34	65/55
7	Multi-Family Residential	35	65/55
8	Multi-Family Residential	42	65/55
9	Multi-Family Residential	41	65/55
10	Single-Family Residential	35	60/50
11	Mobile Home Park	36	65/55
12	Mobile Home Park	36	65/55
13	Mobile Home Park	35	65/55
14	Mobile Home Park	34	65/55
15	Industrial	39	65/60
16	Industrial	38	65/60
17	Industrial	40	65/60
18	Commercial	39	65/55
dB(A) Leq = A-weighted decibels equivalent noise level			

6.0 Conclusions

6.1 Construction Noise

As shown in Table 9, construction noise levels would range from 56 to 73 dB(A) Leq at the adjacent property lines. The City’s Municipal Code does not place noise limit restrictions on construction activities, however, other jurisdictions commonly apply a noise level limit of 75 dB(A) Leq at residential uses. Construction activities would generally occur over the period between 7:00 a.m. and 6:00 p.m. on weekdays. Although the existing adjacent uses would be exposed to construction noise levels that may be heard above ambient conditions, the exposure would be temporary and would not exceed 75 dB(A) Leq. As construction activities associated with the project would comply with the time limits established in Section 10.24.020 (b)(9) of the City Municipal Code, temporary increases in noise levels from construction activities would be less than significant.

6.2 Traffic Noise

6.2.1 On-site Traffic and Rail Noise

The main source of noise at the project site is vehicle traffic on South Santa Fe Avenue and North Las Flores Drive as well as Sprinters on the adjacent rail line. The exterior noise level standard for multi-family uses is 65 CNEL. This standard is applicable at exterior use areas which include second- and third-floor balconies, rooftop decks, and the five proposed amenity areas consisting of active play areas and passive gathering areas. As shown in Table 10, without consideration of any noise barriers, exterior noise levels are projected to range from 42 to 70 CNEL at the building façades and amenity area. Noise levels would be compatible with the City's exterior multi-family noise level standard of 65 CNEL at all locations except the amenity area on the south side of Building 1 (Amenity Area A, Receiver 1) and the south and east sides of Building 1 facing the roadways (Receivers 8 and 9). In order to reduce noise levels at these locations, the project would include a 6-foot barrier adjacent to the amenity area south of Building 1, and a solid 3.5-foot barrier on the balconies located on the south and east sides of Building 1 and on the south and east sides of the Building 1 roof deck. With construction of these barriers, exterior noise levels would be reduced to less than 65 CNEL and exterior noise impacts would be less than significant.

The interior noise level standard is 45 CNEL. Interior noise levels can be reduced through standard construction techniques. When windows are closed, standard construction techniques provide various exterior-to-interior noise level reductions depending on the type of structure and window. Standard light-frame construction would reduce exterior to interior noise levels by at least 20 dB (FHWA 2011). With the installation of windows with an STC rating of 25 or higher, interior noise levels within the units in Building 1 would be reduced to 45 CNEL and interior noise levels would be less than significant. Interior noise levels at all other buildings would be 45 CNEL with standard light frame construction and without consideration of specific building components.

6.2.2 Off-site Traffic Noise

The additional vehicle trips associated with the project would increase noise levels on nearby roadways. A noise increase of 3 dB or more would be considered significant because 3 dB is the level at which an increase in noise is perceptible to a person. As shown in Table 11, the project would not result in a direct or cumulative noise increase of more than 3 dB. Therefore, the project would result in less than significant direct and cumulative impact related to traffic noise.

6.3 On-site Generated Noise

The noise sources on the project site after completion of construction are anticipated to be those that would be typical of any residential use, such as vehicles arriving and leaving, children at play, and landscape maintenance machinery. None of these noise sources are anticipated to violate the City Municipal Code. Rooftop HVAC noise levels were modeled at the adjacent properties. As shown in Table 12, HVAC noise levels would range from 33 to 42 dB(A) L_{eq} . Noise levels would not exceed the applicable Noise Ordinance limits at the property lines.

7.0 References Cited

California Department of Transportation (Caltrans)

2013 Technical Noise Supplement. November.

Federal Highway Administration (FHWA)

2006 Roadway Construction Noise Model. FHWA-HEP-05-054, SOT-VNTSC-FHWA-05-01. Final Report. January.

2008 Roadway Construction Noise Mode, V1.1. Washington, D.C.

2011 Highway Traffic Noise: Analysis and Abatement Guidance. FHWA-HEP-10-025. December.

Federal Transit Administration (FTA)

2018 Transit Noise and Vibration Impact Assessment. FTA Report No. 0123. Prepared by John A. Volpe National Transportation Systems Center. September.

Linscott, Law, & Greenspan, Engineers, Inc. (LLG)

2026 Local Transportation Analysis for the Santa Fe Flores Project. LLG Ref. 3-24-3940. January.

Navcon Engineering, Inc.

2018 SoundPLAN Essential version 4.1.

San Diego Association of Governments (SANDAG)

2025 Transportation Forecast Information Center. Year 2050 ABM2+/2021 RP Traffic Volumes. Accessed January 20, 2025. <https://tfic.sandag.org/>.

San Marcos, City of

2012 City of San Marcos General Plan Update, Noise Element.

ATTACHMENTS

ATTACHMENT 1
Noise Measurement Data

10587 Santa Fe Flores Townhomes
Noise Measurement Data

Summary

Start 2022/03/22 13:34:51
Stop 2022/03/22 13:49:56
Duration 0:15:04.7
Run Time 0:15:02.6
Pause 0:00:02.1

Pre Calibration 2022/03/22 13:33:32
Post Calibration None
Calibration Deviation ---

Overall Settings

RMS Weight A Weighting
Peak Weight A Weighting
Detector Slow
Preamp PRMLxT1
Microphone Correction Off
Integration Method Linear
Overload 144.6 dB

	A	C	Z
Under Range Peak	100.6	97.6	102.6 dB
Under Range Limit	37.8	37.4	44.5 dB
Noise Floor	28.6	28.3	35.3 dB

Results

LAeq 63.2 dB
LAE 92.8 dB
EA 210.368 $\mu\text{Pa}^2\text{h}$
EA8 6.712 mPa^2h
EA40 33.562 mPa^2h
LApeak (max) 2022/03/22 13:37:15 101.8 dB
LASmax 2022/03/22 13:39:26 74.7 dB
LASmin 2022/03/22 13:46:59 51.6 dB
SEA -99.9 dB

LAS > 60.0 dB (Exceedence Counts / Duration)	31	563.6 s
LAS > 70.0 dB (Exceedence Counts / Duration)	6	27.3 s
LApeak > 135.0 dB (Exceedence Counts / Duration)	0	0.0 s
LApeak > 137.0 dB (Exceedence Counts / Duration)	0	0.0 s
LApeak > 140.0 dB (Exceedence Counts / Duration)	0	0.0 s

LCeq 75.2 dB
LAeq 63.2 dB
LCeq - LAeq 12.0 dB
LAleq 65.0 dB
LAeq 63.2 dB
LAleq - LAeq 1.8 dB
Overloads 0
Overload Duration 0.0 s

Dose Settings

Dose Name	OSHA-1	OSHA-2
Exch. Rate	5	5 dB
Threshold	90	80 dB
Criterion Level	90	90 dB
Criterion Duration	8	8 h

Results

Dose	-99.9	-99.9 %
Projected Dose	-99.9	-99.9 %
TWA (Projected)	-99.9	-99.9 dB
TWA (t)	-99.9	-99.9 dB
Lep (t)	48.2	48.2 dB

Statistics

LAS5.00 68.6 dB
LAS10.00 66.6 dB
LAS33.30 62.9 dB
LAS50.00 60.5 dB
LAS66.60 58.4 dB
LAS90.00 55.0 dB

10587 Santa Fe Flores Townhomes
Noise Measurement Data

Summary

Start 2022/03/22 13:55:50
Stop 2022/03/22 14:10:51
Duration 0:15:00.5
Run Time 0:15:00.5
Pause 0:00:00.0

Pre Calibration 2022/03/22 13:33:30
Post Calibration None
Calibration Deviation ---

Overall Settings

RMS Weight A Weighting
Peak Weight A Weighting
Detector Slow
Preamp PRMLxT1
Microphone Correction Off
Integration Method Linear
Overload 144.6 dB

	A	C	Z
Under Range Peak	100.6	97.6	102.6 dB
Under Range Limit	37.8	37.4	44.5 dB
Noise Floor	28.6	28.3	35.3 dB

Results

LAeq 57.5 dB
LAE 87.0 dB
EA 55.989 $\mu\text{Pa}^2\text{h}$
EA8 1.791 mPa^2h
EA40 8.953 mPa^2h
LApeak (max) 2022/03/22 14:03:57 102.3 dB
LASmax 2022/03/22 14:09:26 66.5 dB
LASmin 2022/03/22 14:03:45 49.9 dB
SEA -99.9 dB

LAS > 60.0 dB (Exceedence Counts / Duration) 19 185.3 s
LAS > 70.0 dB (Exceedence Counts / Duration) 0 0.0 s
LApeak > 135.0 dB (Exceedence Counts / Duration) 0 0.0 s
LApeak > 137.0 dB (Exceedence Counts / Duration) 0 0.0 s
LApeak > 140.0 dB (Exceedence Counts / Duration) 0 0.0 s

LCeq 66.1 dB
LAeq 57.5 dB
LCeq - LAeq 8.6 dB
LAleq 59.3 dB
LAeq 57.5 dB
LAleq - LAeq 1.8 dB
Overloads 0
Overload Duration 0.0 s

Dose Settings

Dose Name	OSHA-1	OSHA-2
Exch. Rate	5	5 dB
Threshold	90	80 dB
Criterion Level	90	90 dB
Criterion Duration	8	8 h

Results

Dose -99.9 -99.9 %
Projected Dose -99.9 -99.9 %
TWA (Projected) -99.9 -99.9 dB
TWA (t) -99.9 -99.9 dB
Lep (t) 42.4 42.4 dB

Statistics

LAS5.00 61.7 dB
LAS10.00 60.6 dB
LAS33.30 57.6 dB
LAS50.00 56.1 dB
LAS66.60 54.4 dB
LAS90.00 52.7 dB


ATTACHMENT 2
HVAC Specifications

50VG-A

Performance™ 16 SEER 2-Stage Packaged
Air Conditioner System with Puron® (R-410A)
Refrigerant
Single and Three Phase
2 to 5 Nominal Tons (Sizes 24-60)



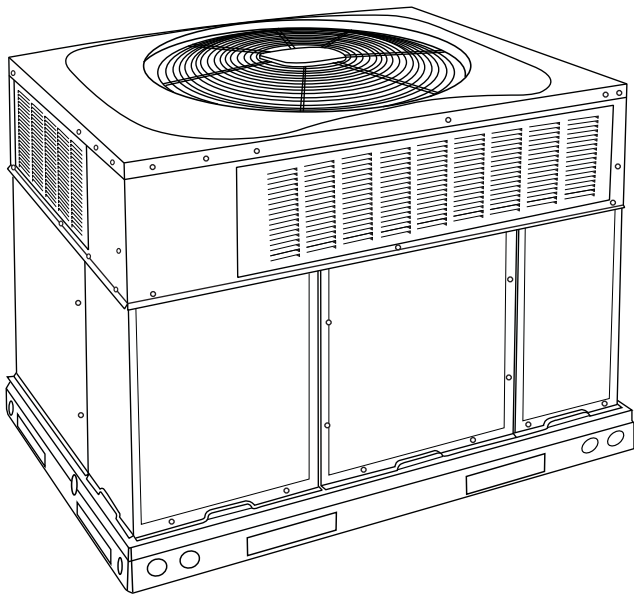Product Data



A09033

Fig. 1 - Unit 50VG-A

Single-Packaged Products with Energy-Saving Features and Puron® refrigerant.

- 15.0-16.0 SEER / 12.0-12.5 EER
- Factory-Installed TXV
- Multi-speed ECM Blower Motor - Standard
- Sound levels as low as 72dBA
- Two Stages of Cooling
- Dehumidification Feature

FEATURES/BENEFITS

One-piece cooling unit with optional electric heater, low sound levels, easy installation, low maintenance, and dependable performance.

Puron Environmentally Sound Refrigerant is Carrier's unique refrigerant designed to help protect the environment. Puron is an HFC refrigerant which does not contain chlorine that can harm the ozone layer. Puron refrigerant is in service in millions of systems proving highly reliable, environmentally sound performance.

Easy Installation

Factory-assembled package is a compact, fully self-contained, electric cooling unit that is prewired, pre-piped, and pre-charged for minimum installation expense. These units are available in a variety of standard cooling sizes with voltage options to meet residential and light commercial requirements. Units are lightweight and install easily on a rooftop or at ground level. The high tech composite base eliminates rust problems associated with ground level applications.

Innovative Unit Base Design

On the inside a high-tech composite material will not rust and incorporates a sloped drain pan which improves drainage and helps inhibit mold, algae and bacterial growth. On the outside metal base rails provide added stability as well as easier handling and rigging.

Convertible duct configuration

Unit is designed for use in either downflow or horizontal applications. Each unit is converted from horizontal to downflow and includes horizontal duct covers. Downflow operation is provided in the field to allow vertical ductwork connections. The basepan seals on the bottom openings to ensure a positive seal in the vertical airflow mode.

Efficient operation High-efficiency design offers SEER (Seasonal Energy Efficiency Ratios) of up to 16.0. (See page 4.)

Durable, dependable components

Scroll Compressors have 2 stages of cooling and are designed for high efficiency. Each compressor is hermetically sealed against contamination to help promote longer life and dependable operation. Each compressor also has vibration isolation to provide quieter operation. All compressors have internal high pressure and overcurrent protection.

Multi-speed ECM Blower Motor is standard on all 50VG-A.

Direct-drive PSC (Permanent Split Capacitor) condenser-fan motors are designed to help reduce energy consumption and provide for cooling operation down to 40°F (4.4°C) outdoor temperature. Motormaster® II low ambient kit is available as a field-installed accessory.

Thermostatic Expansion Valve - A hard shutoff, balance port TXV maintains a constant superheat at the evaporator exit (cooling cycle) resulting in higher overall system efficiency.

Refrigerant system is designed to provide dependability. Liquid filter driers are used to promote clean, unrestricted operation. Each unit leaves the factory with a full refrigerant charge. Refrigerant service connections make checking operating pressures easier.

High and Low Pressure Switches provide added reliability for the compressor.

Indoor and Outdoor coils are computer-designed for optimum heat transfer and efficiency. The indoor coil is fabricated from copper tube and aluminum fins and is located inside the unit for protection against damage. The outdoor coil is internally mounted on the top tier of the unit.

Low sound ratings ensure a quiet indoor and outdoor environment with sound ratings as low as 72dBA. (See Page 4.)

Easy to service cabinets provide easy 3 panel accessibility to serviceable components during maintenance and installation. The basepan with integrated drain pan provides easy ground level installation with a mounting pad. A nesting feature ensures a positive basepan to roof curb seal when the unit is roof mounted. A convenient 3/4-in. (19.05 mm) wide perimeter flange makes frame mounting on a rooftop easy.

AHRI* CAPACITIES

Cooling Capacities and Efficiencies

Unit Model 50VG-A	Nominal Tons	Standard CFM (High / Low Stage)	Net Cooling Capacities - Btuh (High Stage)	EER @A**	SEER†
24	2	800 / 600	23000	12.0	15.0
30	2-1/2	1000 / 750	29000	12.0	15.0
36	3	1200 / 900	35400	12.5	16.0
42	3-1/2	1400 / 1050	42000	12.5	16.0
48	4	1600 / 1200	47500	12.3	16.0
60	5	1750 / 1200	57000	12.3	16.0

LEGEND

dB—Sound Levels (decibels)

db—Dry Bulb

SEER—Seasonal Energy Efficiency Ratio

wb—Wet Bulb

COP—Coefficient of Performance

* Air Conditioning, Heating & Refrigeration Institute.

**At "A" conditions—80°F (26.7°C) indoor db/67°F (19.4°C) indoor wb & 95°F (35°C) outdoor db.

† Rated in accordance with U.S. Government DOE Department of Energy) test procedures and/or AHRI Standards 210/240.

Notes:

1. Ratings are net values, reflecting the effects of circulating fan heat.

Ratings are based on:

Cooling Standard: 80°F (26.7°C) db, 67°F wb (19.4°C) indoor entering—air temperature and 95°F db (35°C) outdoor entering—air temperature.

2. Before purchasing this appliance, read important energy cost and efficiency information available from AHRIdirectory.org.

50VG-A

A-WEIGHTED SOUND POWER LEVEL (dBA)

Model 50VG-A	Sound Ratings (dBA)	TYPICAL OCTAVE BAND SPECTRUM (dBA without tone adjustment)						
		125	250	500	1000	2000	4000	8000
24	73	60.0	62.5	68.5	68.5	64.0	60.0	53.0
30	77	57.5	67.0	73.5	72.0	67.0	61.0	52.5
36	73	62.5	65.5	67.5	68.0	65.5	60.0	52.5
42	73	60.5	63.5	68.0	68.0	66.0	60.5	53.0
48	72	60.0	63.5	66.0	67.0	63.5	58.5	49.5
60	75	69.0	67.0	69.0	68.0	65.0	61.5	54.0

NOTE: Tested in accordance with AHRI Standard 270 (not listed in AHRI).

ATTACHMENT 3

SoundPLAN Data – Construction Noise

10587 Santa Fe Flores Townhomes

SoundPLAN Data - Construction

Source name	Reference	Noise	Corrections		
		Level dB(A)	Cwall dB(A)	CI dB(A)	CT dB(A)
Construction	Lw/unit	116.3	-	-	-

10587 Santa Fe Flores Townhomes

SoundPLAN Data - Construction

No.	Coordinates		Height (meters)	Noise
	X (meters)	Y (meters)		Level dB(A)
1	481468.23	3668972.47	182.38	58.4
2	481477.03	3668933.16	185.26	60.2
3	481491.51	3668901.09	186.46	60.8
4	481513.24	3668863.85	186.82	59.9
5	481534.96	3668832.30	186.16	58.7
6	481452.72	3668803.33	161.69	56.1
7	481417.03	3668787.30	160.02	57.7
8	481389.61	3668758.33	159.09	67.6
9	481373.58	3668720.06	157.61	69.9
10	481348.75	3668660.57	154.54	63.1
11	481317.72	3668679.71	153.92	66.0
12	481280.47	3668693.16	153.14	64.7
13	481232.89	3668717.47	152.07	61.4
14	481185.82	3668741.78	151.46	58.9
15	481288.85	3668803.43	156.64	67.9
16	481306.71	3668845.77	157.91	66.3
17	481370.21	3668885.46	167.46	73.2
18	481303.57	3668756.45	153.75	72.6

Receivers

ATTACHMENT 4

SoundPLAN Data – On-site Traffic and Rail Noise

10587 Santa Fe Flores Townhomes
SoundPLAN Data - Vehicle and Rail Traffic

Station km	ADT Veh/24h	Traffic values			Speed km/h	Control device	Constr. Speed km/h	Affect. veh. %	Road surface	Gradient Min / Max %		
		Vehicles type	Vehicle nar day Veh/h	evening Veh/h							night Veh/h	
S Santa Fe Avenue		Traffic direction:	In entry direction									
0+000	21474	Total	-	1378	716	310	-	none	-	-	Average (of DGAC and PCC)	2.481481481
0+000	21474	Automobiles	-	1282	666	288	72	none	-	-	Average (of DGAC and PCC)	2.481481481
0+000	21474	Medium trucks	-	41	21	9	72	none	-	-	Average (of DGAC and PCC)	2.481481481
0+000	21474	Heavy trucks	-	28	14	6	72	none	-	-	Average (of DGAC and PCC)	2.481481481
0+000	21474	Buses	-	14	7	3	72	none	-	-	Average (of DGAC and PCC)	2.481481481
0+000	21474	Motorcycles	-	14	7	3	72	none	-	-	Average (of DGAC and PCC)	2.481481481
0+000	21474	Auxiliary vehicle	-	-	-	-	-	none	-	-	Average (of DGAC and PCC)	2.481481481
0+426	22566	Total	-	1448	752	326	-	none	-	-	Average (of DGAC and PCC)	-2.923076923
0+426	22566	Automobiles	-	1347	699	303	72	none	-	-	Average (of DGAC and PCC)	-2.923076923
0+426	22566	Medium trucks	-	43	23	10	72	none	-	-	Average (of DGAC and PCC)	-2.923076923
0+426	22566	Heavy trucks	-	29	15	7	72	none	-	-	Average (of DGAC and PCC)	-2.923076923
0+426	22566	Buses	-	14	8	3	72	none	-	-	Average (of DGAC and PCC)	-2.923076923
0+426	22566	Motorcycles	-	14	8	3	72	none	-	-	Average (of DGAC and PCC)	-2.923076923
0+426	22566	Auxiliary vehicle	-	-	-	-	-	none	-	-	Average (of DGAC and PCC)	-2.923076923
0+985	-	-	-	-	-	-	-	-	-	-	-	-
N Las Flores Drive		Traffic direction:	In entry direction									
0+000	3396	Total	-	218	113	49	-	none	-	-	Average (of DGAC and PCC)	42
0+000	3396	Automobiles	-	203	105	46	40	none	-	-	Average (of DGAC and PCC)	42
0+000	3396	Medium trucks	-	7	3	1	40	none	-	-	Average (of DGAC and PCC)	42
0+000	3396	Heavy trucks	-	4	2	1	40	none	-	-	Average (of DGAC and PCC)	42
0+000	3396	Buses	-	2	1	0	40	none	-	-	Average (of DGAC and PCC)	42
0+000	3396	Motorcycles	-	2	1	0	40	none	-	-	Average (of DGAC and PCC)	42
0+000	3396	Auxiliary vehicle	-	-	-	-	-	none	-	-	Average (of DGAC and PCC)	42
0+258	1602	Total	-	103	53	23	-	none	-	-	Average (of DGAC and PCC)	0.0 / 19.3
0+258	1602	Automobiles	-	96	49	21	40	none	-	-	Average (of DGAC and PCC)	0.0 / 19.3
0+258	1602	Medium trucks	-	3	2	1	40	none	-	-	Average (of DGAC and PCC)	0.0 / 19.3
0+258	1602	Heavy trucks	-	2	1	0	40	none	-	-	Average (of DGAC and PCC)	0.0 / 19.3
0+258	1602	Buses	-	1	1	0	40	none	-	-	Average (of DGAC and PCC)	0.0 / 19.3
0+258	1602	Motorcycles	-	1	1	0	40	none	-	-	Average (of DGAC and PCC)	0.0 / 19.3
0+258	1602	Auxiliary vehicle	-	-	-	-	-	none	-	-	Average (of DGAC and PCC)	0.0 / 19.3
0+628	-	-	-	-	-	-	-	-	-	-	-	-

10587 Santa Fe Flores Townhomes
SoundPLAN Data - Vehicle and Rail Traffic

Track Station km	Coordinates of track axis			Track type [dB]	Curve radius [dB]	Multiple reflections [dB]	Corrected mission level		
	X	Y	Z				day	Evening	night
Sprinter	Rail track: Direction:			Section: 1	Km: 0+000				
Train type	Number of trains			Speed	Length per	Max	Emission level		
	day	Evening	night	km/h	train		day	Evening	night
							dB(A)	dB(A)	dB(A)
0	48	12	18	80	80	yes	57.3	57.3	54.3
0+000	481709.9	3668428	173.36	-	-	-	-	57.3	57.3
0+951	481421.7	3669304	162.19	-	-	-	-	57.3	57.3

10587 Santa Fe Flores Townhomes
SoundPLAN Data - Vehicle and Rail Traffic

No.	Coordinates		Floor	Height (meters)	Noise Level without Amenity Area A Barrier				Noise Level with Amenity Area A Barrier				Difference			
	X (meters)	Y (meters)			Day dB(A)	Evening dB(A)	Night dB(A)	CNEL dB(A)	Day dB(A)	Evening dB(A)	Night dB(A)	CNEL dB(A)	Day dB(A)	Evening dB(A)	Night dB(A)	CNEL dB(A)
1	481335.65	3668716.01	1.FI	153.62	66.2	63.3	59.7	68.1	61.8	59.0	55.3	63.7	-4.4	-4.3	-4.3	-4.3
1	481335.65	3668716.01	2.FI	156.72	67.8	64.9	61.3	69.7	67.6	64.8	61.1	69.5	-0.2	-0.2	-0.2	-0.2
1	481335.65	3668716.01	3.FI	159.82	67.8	65.0	61.4	69.7	67.8	65.0	61.3	69.7	0.0	0.0	0.0	0.0
2	481355.89	3668781.10	1.FI	153.90	44.1	41.5	38.0	46.3	44.1	41.5	38.0	46.3	0.0	0.0	0.0	0.0
2	481355.89	3668781.10	2.FI	157.00	47.4	44.8	41.2	49.5	47.4	44.8	41.2	49.5	0.0	0.0	0.0	0.0
2	481355.89	3668781.10	3.FI	160.10	50.8	48.3	44.8	53.0	50.8	48.3	44.8	53.0	0.0	0.0	0.0	0.0
3	481402.17	3668834.91	1.FI	164.87	47.2	45.0	41.6	49.7	47.2	45.0	41.6	49.7	0.0	0.0	0.0	0.0
3	481402.17	3668834.91	2.FI	167.97	51.6	49.2	45.8	53.9	51.5	49.2	45.7	53.8	-0.1	-0.1	-0.1	-0.1
3	481402.17	3668834.91	3.FI	171.07	56.1	53.6	50.1	58.3	56.1	53.6	50.0	58.3	0.0	0.0	0.0	0.0
4	481347.96	3668870.55	1.FI	163.63	42.9	41.4	38.2	46.0	42.9	41.4	38.2	46.0	0.0	0.0	0.0	0.0
4	481347.96	3668870.55	2.FI	166.73	48.6	46.6	43.3	51.3	48.6	46.6	43.3	51.3	0.0	0.0	0.0	0.0
4	481347.96	3668870.55	3.FI	169.83	49.9	48.0	44.6	52.6	49.9	48.0	44.6	52.6	0.0	0.0	0.0	0.0
5	481330.02	3668811.50	1.FI	160.91	51.8	49.1	45.5	53.8	51.8	49.1	45.5	53.8	0.0	0.0	0.0	0.0
5	481330.02	3668811.50	2.FI	164.01	55.0	52.3	48.7	57.0	55.0	52.3	48.6	57.0	0.0	0.0	0.0	0.0
5	481330.02	3668811.50	3.FI	167.11	56.9	54.1	50.5	58.9	56.9	54.1	50.5	58.9	0.0	0.0	0.0	0.0
6	481326.76	3668793.80	1.FI	154.66	39.5	37.5	34.2	42.2	39.5	37.5	34.2	42.2	0.0	0.0	0.0	0.0
6	481326.76	3668793.80	2.FI	157.76	42.1	40.5	37.2	45.1	42.1	40.5	37.2	45.1	0.0	0.0	0.0	0.0
6	481326.76	3668793.80	3.FI	160.86	46.1	44.0	40.5	48.6	46.1	44.0	40.5	48.6	0.0	0.0	0.0	0.0
7	481331.07	3668741.36	1.FI	153.90	59.0	56.2	52.5	60.9	59.0	56.2	52.5	60.9	0.0	0.0	0.0	0.0
7	481331.07	3668741.36	2.FI	157.00	61.4	58.6	54.9	63.3	61.4	58.6	54.9	63.3	0.0	0.0	0.0	0.0
7	481331.07	3668741.36	3.FI	160.10	63.0	60.1	56.5	64.9	63.0	60.1	56.5	64.9	0.0	0.0	0.0	0.0
8	481336.40	3668724.08	1.FI	153.90	65.3	62.5	58.8	67.2	63.1	60.3	56.6	65.0	-2.2	-2.2	-2.2	-2.2
8	481336.40	3668724.08	2.FI	157.00	67.4	64.6	60.9	69.3	67.3	64.4	60.8	69.2	-0.1	-0.1	-0.1	-0.1
8	481336.40	3668724.08	3.FI	160.10	67.9	65.0	61.4	69.8	67.9	65.0	61.4	69.8	0.0	0.0	0.0	0.0
9	481351.47	3668732.17	1.FI	153.96	61.0	58.2	54.6	62.9	60.8	58.0	54.4	62.7	-0.2	-0.2	-0.2	-0.2
9	481351.47	3668732.17	2.FI	157.06	62.6	59.7	56.1	64.5	62.5	59.7	56.0	64.4	-0.1	-0.1	-0.1	-0.1
9	481351.47	3668732.17	3.FI	160.16	63.6	60.8	57.2	65.5	63.6	60.8	57.2	65.5	0.0	0.0	0.0	0.0
10	481344.49	3668750.54	1.FI	153.90	46.6	44.1	40.6	48.8	46.6	44.1	40.6	48.8	0.0	0.0	0.0	0.0
10	481344.49	3668750.54	2.FI	157.00	51.3	48.7	45.1	53.4	51.4	48.7	45.1	53.4	0.0	0.0	0.0	0.0
10	481344.49	3668750.54	3.FI	160.10	53.2	50.6	47.0	55.3	53.2	50.6	47.0	55.3	0.0	0.0	0.0	0.0
11	481359.92	3668758.08	1.FI	153.90	54.7	51.9	48.2	56.6	54.7	51.9	48.3	56.7	0.0	0.0	0.0	0.0
11	481359.92	3668758.08	2.FI	157.00	58.5	55.8	52.1	60.5	58.5	55.8	52.1	60.5	0.0	0.0	0.0	0.0
11	481359.92	3668758.08	3.FI	160.10	59.5	56.7	53.1	61.4	59.5	56.7	53.1	61.4	0.0	0.0	0.0	0.0
12	481355.15	3668776.09	1.FI	153.90	43.9	41.4	37.9	46.1	43.9	41.4	37.9	46.1	0.0	0.0	0.0	0.0
12	481355.15	3668776.09	2.FI	157.00	47.8	45.2	41.7	50.0	47.8	45.2	41.7	50.0	0.0	0.0	0.0	0.0
12	481355.15	3668776.09	3.FI	160.10	49.9	47.5	44.1	52.2	49.9	47.5	44.1	52.2	0.0	0.0	0.0	0.0
13	481339.34	3668768.00	1.FI	153.90	52.2	49.4	45.8	54.2	52.2	49.4	45.8	54.2	0.0	0.0	0.0	0.0
13	481339.34	3668768.00	2.FI	157.00	56.0	53.2	49.6	57.9	56.0	53.2	49.6	57.9	0.0	0.0	0.0	0.0
13	481339.34	3668768.00	3.FI	160.10	57.8	55.0	51.4	59.8	57.8	55.0	51.4	59.8	0.0	0.0	0.0	0.0
14	481360.11	3668813.57	1.FI	164.57	51.9	49.3	45.7	54.0	51.9	49.3	45.7	54.0	0.0	0.0	0.0	0.0
14	481360.11	3668813.57	2.FI	167.67	52.7	50.0	46.4	54.7	52.7	50.0	46.4	54.7	0.0	0.0	0.0	0.0
14	481360.11	3668813.57	3.FI	170.77	53.4	50.8	47.2	55.5	53.4	50.8	47.2	55.5	0.0	0.0	0.0	0.0
15	481366.91	3668795.75	1.FI	164.34	56.2	53.5	49.9	58.2	56.2	53.5	49.9	58.2	0.0	0.0	0.0	0.0
15	481366.91	3668795.75	2.FI	167.44	58.1	55.4	51.7	60.1	58.1	55.4	51.7	60.1	0.0	0.0	0.0	0.0
15	481366.91	3668795.75	3.FI	170.54	59.2	56.4	52.8	61.1	59.2	56.4	52.8	61.1	0.0	0.0	0.0	0.0
16	481386.75	3668803.65	1.FI	164.57	55.1	52.3	48.7	57.0	55.1	52.3	48.7	57.0	0.0	0.0	0.0	0.0
16	481386.75	3668803.65	2.FI	167.67	58.1	55.4	51.9	60.2	58.1	55.4	51.9	60.2	0.0	0.0	0.0	0.0
16	481386.75	3668803.65	3.FI	170.77	58.4	55.7	52.1	60.4	58.4	55.7	52.1	60.4	0.0	0.0	0.0	0.0
17	481379.40	3668822.58	1.FI	164.87	42.6	40.7	37.4	45.3	42.6	40.7	37.4	45.3	0.0	0.0	0.0	0.0
17	481379.40	3668822.58	2.FI	167.97	46.5	44.8	41.5	49.4	46.5	44.8	41.5	49.4	0.0	0.0	0.0	0.0
17	481379.40	3668822.58	3.FI	171.07	47.6	45.9	42.6	50.5	47.6	45.9	42.6	50.5	0.0	0.0	0.0	0.0
18	481397.04	3668829.19	1.FI	164.87	48.6	46.4	42.9	51.0	48.6	46.4	42.9	51.0	0.0	0.0	0.0	0.0
18	481397.04	3668829.19	2.FI	167.97	52.7	50.2	46.7	54.9	52.8	50.2	46.7	54.9	0.0	0.0	0.0	0.0
18	481397.04	3668829.19	3.FI	171.07	56.6	54.0	50.5	58.7	56.6	54.0	50.5	58.7	0.0	0.0	0.0	0.0
19	481390.79	3668848.85	1.FI	164.87	44.6	43.8	40.6	48.3	44.6	43.8	40.6	48.3	0.0	0.0	0.0	0.0
19	481390.79	3668848.85	2.FI	167.97	46.8	46.0	42.8	50.5	46.8	46.0	42.8	50.5	0.0	0.0	0.0	0.0
19	481390.79	3668848.85	3.FI	171.07	48.1	47.2	44.0	51.7	48.1	47.2	44.0	51.7	0.0	0.0	0.0	0.0
20	481372.23	3668840.95	1.FI	164.87	43.2	41.5	38.2	46.1	43.2	41.5	38.2	46.1	0.0	0.0	0.0	0.0
20	481372.23	3668840.95	2.FI	167.97	48.8	46.5	43.0	51.2	48.8	46.5	43.0	51.2	0.0	0.0	0.0	0.0
20	481372.23	3668840.95	3.FI	171.07	49.5	47.2	43.7	51.9	49.5	47.2	43.7	51.9	0.0	0.0	0.0	0.0
21	481358.45	3668847.75	1.FI	163.35	42.9	41.6	38.4	46.2	42.9	41.6	38.4	46.2	0.0	0.0	0.0	0.0
21	481358.45	3668847.75	2.FI	166.45	47.2	45.3	41.9	49.9	47.2	45.3	41.9	49.9	0.0	0.0	0.0	0.0
21	481358.45	3668847.75	3.FI	169.55	48.2	46.3	43.0	51.0	48.2	46.3	43.0	51.0	0.0	0.0	0.0	0.0
22	481354.78	3668864.47	1.FI	163.35	41.6	40.4	37.2	45.0	41.6	40.4	37.2	45.0	0.0	0.0	0.0	0.0
22	481354.78	3668864.47	2.FI	166.45	45.8	44.6	41.5	49.2	45.8	44.6	41.5	49.2	0.0	0.0	0.0	0.0
22	481354.78	3668864.47	3.FI	169.55	46.9	45.7	42.5	50.2	46.9	45.7	42.5	50.2	0.0	0.0	0.0	0.0
23	481338.24	3668856.75	1.FI	163.36	46.2	43.5	39.9	48.2	46.2	43.5	39.9	48.2	0.0	0.0	0.0	0.0
23	481338.24	3668856.75	2.FI	166.46	52.4	49.7	46.1	54.4	52.4	49.7	46.1	54.4	0.0	0.0	0.0	0.0
23	481338.24	3668856.75	3.FI	169.56	53.8	51.1	47.5	55.8	53.8	51.1	47.5	55.8	0.0	0.0	0.0	0.0
24	481341.92	3668839.85	1.FI	162.53	40.3	38.5	35.1	43.1	40.3	38.5	35.1	43.1	0.0	0.0	0.0	0.0
24	481341.92	3668839.85	2.FI	165.63	46.1	44.0	40.5	48.6	46.1	44.0	40.5	48.6	0.0	0.0	0.0	0.0
24	481341.92	3668839.85	3.FI	168.73	48.0	45.7	42.2	50.3	48.0	45.7	42.2	50.3	0.0	0.0	0.0	0.0
25	481326.48	3668829.93	1.FI	161.82	49.1	46.4	42.8	51.1	49.1	46.4	42.8	51.1	0.0	0.0	0.0	0.0
25	481326.48	3668829.93	2.FI	164.92	53.7	50.9										

10587 Santa Fe Flores Townhomes
SoundPLAN Data - Vehicle and Rail Traffic

Source name	Noise Level without Amenity Area A Barrier				Noise Level with Amenity Area A Barrier			
	Day dB(A)	Evening dB(A)	Night dB(A)	CNEL dB(A)	Day dB(A)	Evening dB(A)	Night dB(A)	CNEL dB(A)
1 1.FI 66.2 63.3 59.7 68.1 61.8 59.0 55.3 63.7								
N Las Flores Drive	51.4	48.5	44.9	53.3	47.0	44.1	40.5	48.9
S Santa Fe Avenue	66.0	63.2	59.5	67.9	61.6	58.8	55.2	63.5
Sprinter	37.8	37.8	34.8	42.2	37.7	37.7	34.7	42.2
1 2.FI 67.8 64.9 61.3 69.7 67.6 64.8 61.1 69.5								
N Las Flores Drive	52.9	50.0	46.4	54.8	52.7	49.8	46.2	54.6
S Santa Fe Avenue	67.6	64.8	61.2	69.5	67.5	64.6	61.0	69.4
Sprinter	38.3	38.3	35.3	42.8	38.3	38.3	35.3	42.7
1 3.FI 67.8 65.0 61.4 69.7 67.8 65.0 61.3 69.7								
N Las Flores Drive	53.0	50.1	46.5	54.9	53.0	50.1	46.5	54.9
S Santa Fe Avenue	67.7	64.8	61.2	69.6	67.7	64.8	61.2	69.6
Sprinter	39.7	39.7	36.7	44.1	39.6	39.6	36.6	44.1
2 1.FI 44.1 41.5 38.0 46.3 44.1 41.5 38.0 46.3								
N Las Flores Drive	42.7	39.8	36.2	44.5	42.7	39.8	36.2	44.5
S Santa Fe Avenue	37.6	34.7	31.1	39.5	37.6	34.7	31.1	39.5
Sprinter	32.5	32.5	29.5	36.9	32.5	32.5	29.5	36.9
2 2.FI 47.4 44.8 41.2 49.5 47.4 44.8 41.2 49.5								
N Las Flores Drive	46.2	43.4	39.7	48.1	46.2	43.4	39.7	48.1
S Santa Fe Avenue	39.8	36.9	33.3	41.7	39.8	36.9	33.3	41.7
Sprinter	35.3	35.3	32.2	39.7	35.3	35.3	32.2	39.7
2 3.FI 50.8 48.3 44.8 53.0 50.8 48.3 44.8 53.0								
N Las Flores Drive	48.4	45.5	41.9	50.3	48.4	45.5	41.9	50.3
S Santa Fe Avenue	46.1	43.3	39.6	48.0	46.1	43.3	39.6	48.0
Sprinter	40.2	40.2	37.2	44.7	40.2	40.2	37.2	44.7
3 1.FI 47.2 45.0 41.6 49.7 47.2 45.0 41.6 49.7								
N Las Flores Drive	45.2	42.4	38.7	47.1	45.2	42.3	38.7	47.1
S Santa Fe Avenue	39.9	37.1	33.5	41.8	39.8	36.9	33.3	41.7
Sprinter	39.8	39.8	36.8	44.2	39.8	39.8	36.8	44.2
3 2.FI 51.6 49.2 45.8 53.9 51.5 49.2 45.7 53.8								
N Las Flores Drive	48.3	45.5	41.8	50.2	48.3	45.5	41.8	50.2
S Santa Fe Avenue	47.7	44.8	41.2	49.6	47.4	44.6	40.9	49.3
Sprinter	42.7	42.7	39.7	47.1	42.7	42.7	39.7	47.1
3 3.FI 56.1 53.6 50.1 58.3 56.1 53.6 50.0 58.3								
N Las Flores Drive	52.0	49.1	45.5	53.9	52.0	49.1	45.5	53.9
S Santa Fe Avenue	53.4	50.5	46.9	55.3	53.3	50.5	46.8	55.2
Sprinter	45.3	45.3	42.3	49.7	45.3	45.3	42.3	49.7
4 1.FI 42.9 41.4 38.2 46.0 42.9 41.4 38.2 46.0								
N Las Flores Drive	36.7	33.8	30.2	38.6	36.7	33.8	30.2	38.6
S Santa Fe Avenue	38.5	35.7	32.0	40.4	38.5	35.7	32.0	40.4
Sprinter	39.0	39.0	35.9	43.4	39.0	39.0	35.9	43.4
4 2.FI 48.6 46.6 43.3 51.3 48.6 46.6 43.3 51.3								
N Las Flores Drive	37.2	34.3	30.7	39.1	37.2	34.3	30.7	39.1
S Santa Fe Avenue	46.8	44.0	40.4	48.7	46.8	44.0	40.4	48.7
Sprinter	42.6	42.6	39.6	47.1	42.6	42.6	39.6	47.1
4 3.FI 49.9 48.0 44.6 52.6 49.9 48.0 44.6 52.6								
N Las Flores Drive	37.7	34.8	31.2	39.6	37.7	34.8	31.2	39.6
S Santa Fe Avenue	48.4	45.5	41.9	50.3	48.4	45.5	41.9	50.3
Sprinter	43.7	43.7	40.7	48.2	43.7	43.7	40.7	48.2
5 1.FI 51.8 49.1 45.5 53.8 51.8 49.1 45.5 53.8								
N Las Flores Drive	38.8	35.9	32.3	40.7	38.8	35.9	32.3	40.7
S Santa Fe Avenue	51.5	48.7	45.0	53.4	51.5	48.7	45.0	53.4
Sprinter	36.0	36.0	33.0	40.4	36.0	36.0	33.0	40.4
5 2.FI 55.0 52.3 48.7 57.0 55.0 52.3 48.6 57.0								
N Las Flores Drive	40.6	37.7	34.1	42.5	40.6	37.7	34.1	42.5
S Santa Fe Avenue	54.8	51.9	48.3	56.7	54.8	51.9	48.3	56.7
Sprinter	37.7	37.7	34.7	42.1	37.7	37.7	34.7	42.1
5 3.FI 56.9 54.1 50.5 58.9 56.9 54.1 50.5 58.9								
N Las Flores Drive	41.8	39.0	35.3	43.7	41.8	39.0	35.3	43.7
S Santa Fe Avenue	56.7	53.9	50.3	58.6	56.7	53.9	50.2	58.6
Sprinter	38.6	38.6	35.6	43.1	38.6	38.6	35.6	43.1
6 1.FI 39.5 37.5 34.2 42.2 39.5 37.5 34.2 42.2								
N Las Flores Drive	36.4	33.6	29.9	38.3	36.4	33.6	29.9	38.3
S Santa Fe Avenue	33.5	30.7	27.0	35.4	33.5	30.7	27.0	35.4
Sprinter	33.5	33.5	30.5	37.9	33.5	33.5	30.5	37.9
6 2.FI 42.1 40.5 37.2 45.1 42.1 40.5 37.2 45.1								
N Las Flores Drive	38.5	35.6	32.0	40.4	38.5	35.6	32.0	40.4
S Santa Fe Avenue	35.8	32.9	29.3	37.7	35.8	32.9	29.3	37.7
Sprinter	37.5	37.5	34.4	41.9	37.5	37.5	34.4	41.9
6 3.FI 46.1 44.0 40.5 48.6 46.1 44.0 40.5 48.6								
N Las Flores Drive	40.0	37.2	33.5	41.9	40.0	37.2	33.5	41.9
S Santa Fe Avenue	43.6	40.7	37.1	45.5	43.6	40.7	37.1	45.5
Sprinter	39.0	39.0	36.0	43.4	39.0	39.0	36.0	43.4
7 1.FI 59.0 56.2 52.5 60.9 59.0 56.2 52.5 60.9								
N Las Flores Drive	25.6	22.7	19.1	27.5	25.6	22.7	19.1	27.5
S Santa Fe Avenue	59.0	56.1	52.5	60.9	59.0	56.1	52.5	60.9
Sprinter	33.3	33.3	30.3	37.7	33.3	33.3	30.3	37.7
7 2.FI 61.4 58.6 54.9 63.3 61.4 58.6 54.9 63.3								
N Las Flores Drive	27.6	24.7	21.1	29.5	27.6	24.7	21.1	29.5
S Santa Fe Avenue	61.4	58.5	54.9	63.3	61.4	58.5	54.9	63.3
Sprinter	33.7	33.7	30.7	38.1	33.7	33.7	30.7	38.1
7 3.FI 63.0 60.1 56.5 64.9 63.0 60.1 56.5 64.9								
N Las Flores Drive	31.0	28.1	24.5	32.9	31.0	28.1	24.5	32.9
S Santa Fe Avenue	63.0	60.1	56.5	64.9	63.0	60.1	56.5	64.9
Sprinter	34.1	34.1	31.1	38.5	34.1	34.1	31.1	38.5

10587 Santa Fe Flores Townhomes
SoundPLAN Data - Vehicle and Rail Traffic

Source name	Noise Level without Amenity Area A Barrier								Noise Level with Amenity Area A Barrier				
	Day dB(A)	Evening dB(A)	Night dB(A)	CNEL dB(A)	Day dB(A)	Evening dB(A)	Night dB(A)	CNEL dB(A)					
8 1.FI 65.3 62.5 58.8 67.2 63.1 60.3 56.6 65.0													
N Las Flores Drive	50.3	47.4	43.8	52.2	46.4	43.5	39.9	48.3					
S Santa Fe Avenue	65.2	62.3	58.7	67.1	63.0	60.2	56.5	64.9					
Sprinter	36.2	36.2	33.2	40.6	36.1	36.1	33.1	40.5					
8 2.FI 67.4 64.6 60.9 69.3 67.3 64.4 60.8 69.2													
N Las Flores Drive	51.9	49.0	45.4	53.8	51.5	48.6	45.0	53.4					
S Santa Fe Avenue	67.3	64.4	60.8	69.2	67.2	64.3	60.7	69.1					
Sprinter	36.2	36.2	33.2	40.6	36.2	36.2	33.2	40.6					
8 3.FI 67.9 65.0 61.4 69.8 67.9 65.0 61.4 69.8													
N Las Flores Drive	52.1	49.2	45.6	54.0	52.1	49.2	45.6	54.0					
S Santa Fe Avenue	67.8	64.9	61.3	69.7	67.8	64.9	61.3	69.7					
Sprinter	37.2	37.2	34.2	41.6	37.2	37.2	34.1	41.6					
9 1.FI 61.0 58.2 54.6 62.9 60.8 58.0 54.4 62.7													
N Las Flores Drive	55.1	52.2	48.6	56.9	55.0	52.1	48.5	56.9					
S Santa Fe Avenue	59.7	56.8	53.2	61.6	59.4	56.6	52.9	61.3					
Sprinter	40.1	40.1	37.1	44.6	40.1	40.1	37.1	44.6					
9 2.FI 62.6 59.7 56.1 64.5 62.5 59.7 56.0 64.4													
N Las Flores Drive	56.2	53.3	49.7	58.1	56.2	53.3	49.7	58.1					
S Santa Fe Avenue	61.4	58.5	54.9	63.3	61.3	58.4	54.8	63.2					
Sprinter	41.3	41.3	38.3	45.8	41.3	41.3	38.3	45.8					
9 3.FI 63.6 60.8 57.2 65.5 63.6 60.8 57.2 65.5													
N Las Flores Drive	56.0	53.1	49.5	57.8	56.0	53.1	49.5	57.9					
S Santa Fe Avenue	62.8	59.9	56.3	64.7	62.7	59.9	56.3	64.6					
Sprinter	42.4	42.4	39.4	46.8	42.4	42.4	39.4	46.8					
10 1.FI 46.6 44.1 40.6 48.8 46.6 44.1 40.6 48.8													
N Las Flores Drive	41.3	38.4	34.8	43.2	41.3	38.4	34.8	43.2					
S Santa Fe Avenue	44.2	41.4	37.8	46.1	44.2	41.4	37.8	46.1					
Sprinter	37.2	37.2	34.2	41.6	37.2	37.2	34.2	41.6					
10 2.FI 51.3 48.7 45.1 53.4 51.4 48.7 45.1 53.4													
N Las Flores Drive	45.1	42.2	38.6	47.0	45.1	42.2	38.6	47.0					
S Santa Fe Avenue	49.9	47.0	43.4	51.8	49.9	47.0	43.4	51.8					
Sprinter	38.4	38.4	35.4	42.8	38.4	38.4	35.4	42.8					
10 3.FI 53.2 50.6 47.0 55.3 53.2 50.6 47.0 55.3													
N Las Flores Drive	45.1	42.2	38.6	47.0	45.1	42.2	38.6	47.0					
S Santa Fe Avenue	52.3	49.4	45.8	54.2	52.3	49.4	45.8	54.2					
Sprinter	40.2	40.2	37.2	44.7	40.2	40.2	37.2	44.7					
11 1.FI 54.7 51.9 48.2 56.6 54.7 51.9 48.3 56.7													
N Las Flores Drive	50.1	47.2	43.6	52.0	50.1	47.2	43.6	52.0					
S Santa Fe Avenue	52.8	50.0	46.3	54.7	52.9	50.0	46.4	54.8					
Sprinter	31.6	31.6	28.6	36.0	31.6	31.6	28.6	36.0					
11 2.FI 58.5 55.8 52.1 60.5 58.5 55.8 52.1 60.5													
N Las Flores Drive	54.7	51.8	48.2	56.6	54.7	51.8	48.2	56.6					
S Santa Fe Avenue	56.1	53.2	49.6	58.0	56.1	53.3	49.6	58.0					
Sprinter	40.9	40.9	37.9	45.3	40.9	40.9	37.9	45.3					
11 3.FI 59.5 56.7 53.1 61.4 59.5 56.7 53.1 61.4													
N Las Flores Drive	54.8	51.9	48.3	56.7	54.8	51.9	48.3	56.7					
S Santa Fe Avenue	57.5	54.7	51.1	59.4	57.5	54.7	51.1	59.4					
Sprinter	42.2	42.2	39.2	46.6	42.2	42.2	39.2	46.6					
12 1.FI 43.9 41.4 37.9 46.1 43.9 41.4 37.9 46.1													
N Las Flores Drive	43.1	40.2	36.5	44.9	43.1	40.2	36.5	44.9					
S Santa Fe Avenue	32.4	29.6	26.0	34.3	32.4	29.6	26.0	34.3					
Sprinter	33.8	33.8	30.8	38.3	33.8	33.8	30.8	38.3					
12 2.FI 47.8 45.2 41.7 50.0 47.8 45.2 41.7 50.0													
N Las Flores Drive	47.2	44.4	40.7	49.1	47.2	44.4	40.7	49.1					
S Santa Fe Avenue	33.3	30.4	26.8	35.2	33.3	30.4	26.8	35.2					
Sprinter	37.0	37.0	34.0	41.5	37.0	37.0	34.0	41.5					
12 3.FI 49.9 47.5 44.1 52.2 49.9 47.5 44.1 52.2													
N Las Flores Drive	49.0	46.1	42.5	50.8	49.0	46.1	42.5	50.8					
S Santa Fe Avenue	37.5	34.7	31.0	39.4	37.5	34.7	31.0	39.4					
Sprinter	41.3	41.3	38.3	45.7	41.3	41.3	38.3	45.7					
13 1.FI 52.2 49.4 45.8 54.2 52.2 49.4 45.8 54.2													
N Las Flores Drive	31.0	28.1	24.5	32.9	31.0	28.1	24.5	32.9					
S Santa Fe Avenue	52.1	49.3	45.7	54.0	52.1	49.3	45.7	54.0					
Sprinter	33.1	33.1	30.0	37.5	33.1	33.1	30.0	37.5					
13 2.FI 56.0 53.2 49.6 57.9 56.0 53.2 49.6 57.9													
N Las Flores Drive	32.5	29.6	26.0	34.4	32.5	29.6	26.0	34.4					
S Santa Fe Avenue	55.9	53.1	49.4	57.8	55.9	53.1	49.4	57.8					
Sprinter	36.6	36.6	33.6	41.1	36.6	36.6	33.6	41.1					
13 3.FI 57.8 55.0 51.4 59.8 57.8 55.0 51.4 59.8													
N Las Flores Drive	34.5	31.7	28.0	36.4	34.5	31.7	28.0	36.4					
S Santa Fe Avenue	57.7	54.9	51.3	59.6	57.7	54.9	51.3	59.6					
Sprinter	38.6	38.6	35.6	43.0	38.6	38.6	35.6	43.0					
14 1.FI 51.9 49.3 45.7 54.0 51.9 49.3 45.7 54.0													
N Las Flores Drive	34.9	32.1	28.4	36.8	35.0	32.1	28.5	36.8					
S Santa Fe Avenue	51.6	48.8	45.2	53.5	51.6	48.8	45.2	53.5					
Sprinter	38.6	38.6	35.6	43.0	38.6	38.6	35.6	43.0					
14 2.FI 52.7 50.0 46.4 54.7 52.7 50.0 46.4 54.7													
N Las Flores Drive	35.5	32.6	29.0	37.4	35.5	32.7	29.0	37.4					
S Santa Fe Avenue	52.4	49.5	45.9	54.3	52.4	49.5	45.9	54.3					
Sprinter	39.0	39.0	36.0	43.4	39.0	39.0	36.0	43.4					
14 3.FI 53.4 50.8 47.2 55.5 53.4 50.8 47.2 55.5													
N Las Flores Drive	35.8	32.9	29.3	37.7	35.8	33.0	29.3	37.7					
S Santa Fe Avenue	53.2	50.3	46.7	55.1	53.2	50.3	46.7	55.1					
Sprinter	39.5	39.5	36.5	43.9	39.5	39.5	36.5	43.9					

10587 Santa Fe Flores Townhomes
SoundPLAN Data - Vehicle and Rail Traffic

Source name	Noise Level without Amenity Area A Barrier				Noise Level with Amenity Area A Barrier			
	Day dB(A)	Evening dB(A)	Night dB(A)	CNEL dB(A)	Day dB(A)	Evening dB(A)	Night dB(A)	CNEL dB(A)
15 1.FI 56.2 53.5 49.9 58.2 56.2 53.5 49.9 58.2								
N Las Flores Drive	48.9	46.0	42.4	50.8	48.9	46.0	42.4	50.8
S Santa Fe Avenue	55.2	52.4	48.8	57.1	55.2	52.4	48.8	57.1
Sprinter	39.5	39.5	36.5	44.0	39.5	39.5	36.5	44.0
15 2.FI 58.1 55.4 51.7 60.1 58.1 55.4 51.7 60.1								
N Las Flores Drive	50.1	47.2	43.6	52.0	50.1	47.2	43.6	52.0
S Santa Fe Avenue	57.3	54.5	50.8	59.2	57.3	54.5	50.8	59.2
Sprinter	40.6	40.6	37.6	45.0	40.6	40.6	37.6	45.0
15 3.FI 59.2 56.4 52.8 61.1 59.2 56.4 52.8 61.1								
N Las Flores Drive	50.2	47.3	43.7	52.0	50.2	47.3	43.7	52.0
S Santa Fe Avenue	58.5	55.6	52.0	60.4	58.5	55.6	52.0	60.4
Sprinter	41.4	41.4	38.4	45.8	41.4	41.4	38.4	45.8
16 1.FI 55.1 52.3 48.7 57.0 55.1 52.3 48.7 57.0								
N Las Flores Drive	51.8	48.9	45.3	53.7	51.8	48.9	45.3	53.7
S Santa Fe Avenue	52.1	49.2	45.6	54.0	52.1	49.3	45.6	54.0
Sprinter	38.5	38.5	35.5	42.9	38.5	38.5	35.5	42.9
16 2.FI 58.1 55.4 51.9 60.2 58.1 55.4 51.9 60.2								
N Las Flores Drive	55.2	52.3	48.7	57.1	55.2	52.3	48.7	57.1
S Santa Fe Avenue	54.6	51.7	48.1	56.5	54.6	51.8	48.1	56.5
Sprinter	44.5	44.5	41.5	48.9	44.5	44.5	41.5	48.9
16 3.FI 58.4 55.7 52.1 60.4 58.4 55.7 52.1 60.4								
N Las Flores Drive	55.0	52.1	48.5	56.9	55.0	52.1	48.5	56.9
S Santa Fe Avenue	55.2	52.3	48.7	57.1	55.2	52.3	48.7	57.1
Sprinter	45.7	45.7	42.7	50.1	45.7	45.7	42.7	50.1
17 1.FI 42.6 40.7 37.4 45.3 42.6 40.7 37.4 45.3								
N Las Flores Drive	40.4	37.6	33.9	42.3	40.4	37.6	33.9	42.3
S Santa Fe Avenue	33.4	30.6	27.0	35.3	33.4	30.6	27.0	35.3
Sprinter	36.9	36.9	33.9	41.4	36.9	36.9	33.9	41.4
17 2.FI 46.5 44.8 41.5 49.4 46.5 44.8 41.5 49.4								
N Las Flores Drive	43.7	40.8	37.1	45.5	43.7	40.8	37.1	45.5
S Santa Fe Avenue	38.3	35.4	31.8	40.2	38.3	35.4	31.8	40.2
Sprinter	41.7	41.7	38.7	46.1	41.7	41.7	38.7	46.1
17 3.FI 47.6 45.9 42.6 50.5 47.6 45.9 42.6 50.5								
N Las Flores Drive	44.1	41.2	37.6	45.9	44.1	41.2	37.6	45.9
S Santa Fe Avenue	41.5	38.6	35.0	43.4	41.5	38.6	35.0	43.4
Sprinter	42.6	42.6	39.6	47.1	42.6	42.6	39.6	47.1
18 1.FI 48.6 46.4 42.9 51.0 48.6 46.4 42.9 51.0								
N Las Flores Drive	46.2	43.3	39.6	48.0	46.2	43.3	39.6	48.0
S Santa Fe Avenue	42.9	40.1	36.4	44.8	42.9	40.1	36.5	44.8
Sprinter	40.7	40.7	37.7	45.2	40.7	40.7	37.7	45.2
18 2.FI 52.7 50.2 46.7 54.9 52.7 50.2 46.7 54.9								
N Las Flores Drive	49.4	46.5	42.9	51.3	49.4	46.5	42.9	51.3
S Santa Fe Avenue	49.3	46.5	42.8	51.2	49.3	46.5	42.9	51.2
Sprinter	42.2	42.2	39.2	46.6	42.2	42.2	39.2	46.6
18 3.FI 56.6 54.0 50.5 58.7 56.6 54.0 50.5 58.7								
N Las Flores Drive	52.7	49.9	46.2	54.6	52.7	49.9	46.2	54.6
S Santa Fe Avenue	53.6	50.8	47.1	55.5	53.6	50.8	47.2	55.5
Sprinter	45.5	45.5	42.5	49.9	45.5	45.5	42.5	49.9
19 1.FI 44.6 43.8 40.6 48.3 44.6 43.8 40.6 48.3								
N Las Flores Drive	39.9	37.0	33.4	41.7	39.9	37.0	33.4	41.7
S Santa Fe Avenue	30.7	27.9	24.2	32.6	30.7	27.9	24.2	32.6
Sprinter	42.6	42.6	39.6	47.0	42.6	42.6	39.6	47.0
19 2.FI 46.8 46.0 42.8 50.5 46.8 46.0 42.8 50.5								
N Las Flores Drive	40.8	37.9	34.3	42.7	40.8	37.9	34.3	42.7
S Santa Fe Avenue	37.7	34.9	31.3	39.6	37.7	34.9	31.2	39.6
Sprinter	44.8	44.8	41.8	49.2	44.8	44.8	41.8	49.2
19 3.FI 48.1 47.2 44.0 51.7 48.1 47.2 44.0 51.7								
N Las Flores Drive	42.5	39.6	36.0	44.4	42.5	39.6	36.0	44.4
S Santa Fe Avenue	39.6	36.7	33.1	41.5	39.6	36.7	33.1	41.5
Sprinter	45.8	45.8	42.8	50.3	45.8	45.8	42.8	50.3
20 1.FI 43.2 41.5 38.2 46.1 43.2 41.5 38.2 46.1								
N Las Flores Drive	32.1	29.2	25.6	34.0	32.1	29.2	25.6	34.0
S Santa Fe Avenue	41.0	38.1	34.5	42.9	41.0	38.1	34.5	42.9
Sprinter	38.3	38.3	35.3	42.7	38.3	38.3	35.3	42.7
20 2.FI 48.8 46.5 43.0 51.2 48.8 46.5 43.0 51.2								
N Las Flores Drive	33.0	30.2	26.5	34.9	33.0	30.2	26.5	34.9
S Santa Fe Avenue	48.1	45.2	41.6	50.0	48.1	45.2	41.6	50.0
Sprinter	40.1	40.1	37.1	44.5	40.1	40.1	37.1	44.5
20 3.FI 49.5 47.2 43.7 51.9 49.5 47.2 43.7 51.9								
N Las Flores Drive	31.7	28.8	25.2	33.6	31.7	28.8	25.2	33.6
S Santa Fe Avenue	48.8	45.9	42.3	50.7	48.8	45.9	42.3	50.7
Sprinter	40.9	40.9	37.9	45.4	40.9	40.9	37.9	45.4
21 1.FI 42.9 41.6 38.4 46.2 42.9 41.6 38.4 46.2								
N Las Flores Drive	33.8	31.0	27.3	35.7	33.8	31.0	27.4	35.7
S Santa Fe Avenue	39.0	36.2	32.6	40.9	39.0	36.2	32.6	40.9
Sprinter	39.6	39.6	36.6	44.1	39.6	39.6	36.6	44.1
21 2.FI 47.2 45.3 41.9 49.9 47.2 45.3 41.9 49.9								
N Las Flores Drive	35.8	33.0	29.3	37.7	35.8	33.0	29.3	37.7
S Santa Fe Avenue	45.4	42.5	38.9	47.3	45.4	42.5	38.9	47.3
Sprinter	41.5	41.5	38.5	45.9	41.5	41.5	38.5	45.9
21 3.FI 48.2 46.3 43.0 51.0 48.2 46.3 43.0 51.0								
N Las Flores Drive	37.8	34.9	31.3	39.7	37.8	35.0	31.3	39.7
S Santa Fe Avenue	46.2	43.4	39.8	48.1	46.2	43.4	39.8	48.1
Sprinter	42.6	42.6	39.6	47.0	42.6	42.6	39.6	47.0

10587 Santa Fe Flores Townhomes
SoundPLAN Data - Vehicle and Rail Traffic

Source name	Noise Level without Amenity Area A Barrier								Noise Level with Amenity Area A Barrier				
	Day dB(A)	Evening dB(A)	Night dB(A)	CNEL dB(A)	Day dB(A)	Evening dB(A)	Night dB(A)	CNEL dB(A)					
22 1.FI 41.6 40.4 37.2 45.0 41.6 40.4 37.2 45.0													
N Las Flores Drive	37.2	34.3	30.7	39.1	37.2	34.3	30.7	39.1					
S Santa Fe Avenue	32.3	29.4	25.8	34.2	32.3	29.4	25.8	34.2					
Sprinter	38.7	38.7	35.7	43.2	38.7	38.7	35.7	43.2					
22 2.FI 45.8 44.6 41.5 49.2 45.8 44.6 41.5 49.2													
N Las Flores Drive	38.2	35.3	31.7	40.1	38.2	35.3	31.7	40.1					
S Santa Fe Avenue	40.4	37.6	34.0	42.3	40.4	37.6	34.0	42.3					
Sprinter	43.0	43.0	40.0	47.4	43.0	43.0	40.0	47.4					
22 3.FI 46.9 45.7 42.5 50.2 46.9 45.7 42.5 50.2													
N Las Flores Drive	38.7	35.8	32.2	40.6	38.7	35.8	32.2	40.6					
S Santa Fe Avenue	42.0	39.2	35.6	43.9	42.0	39.2	35.6	43.9					
Sprinter	44.0	44.0	41.0	48.4	44.0	44.0	41.0	48.4					
23 1.FI 46.2 43.5 39.9 48.2 46.2 43.5 39.9 48.2													
N Las Flores Drive	17.7	14.8	11.2	19.6	17.7	14.8	11.2	19.6					
S Santa Fe Avenue	46.0	43.1	39.5	47.9	46.0	43.1	39.5	47.9					
Sprinter	32.7	32.7	29.6	37.1	32.7	32.7	29.6	37.1					
23 2.FI 52.4 49.7 46.1 54.4 52.4 49.7 46.1 54.4													
N Las Flores Drive	18.6	15.8	12.1	20.5	18.6	15.8	12.1	20.5					
S Santa Fe Avenue	52.3	49.5	45.8	54.2	52.3	49.5	45.8	54.2					
Sprinter	37.1	37.1	34.1	41.6	37.1	37.1	34.1	41.6					
23 3.FI 53.8 51.1 47.5 55.8 53.8 51.1 47.5 55.8													
N Las Flores Drive	23.3	20.5	16.8	25.2	23.3	20.5	16.8	25.2					
S Santa Fe Avenue	53.7	50.9	47.2	55.6	53.7	50.9	47.2	55.6					
Sprinter	38.1	38.1	35.1	42.5	38.1	38.1	35.1	42.5					
24 1.FI 40.3 38.5 35.1 43.1 40.3 38.5 35.1 43.1													
N Las Flores Drive	30.6	27.8	24.1	32.5	30.6	27.8	24.1	32.5					
S Santa Fe Avenue	38.0	35.2	31.6	39.9	38.0	35.2	31.6	39.9					
Sprinter	35.0	35.0	31.9	39.4	35.0	35.0	31.9	39.4					
24 2.FI 46.1 44.0 40.5 48.6 46.1 44.0 40.5 48.6													
N Las Flores Drive	30.2	27.4	23.7	32.1	30.2	27.4	23.7	32.1					
S Santa Fe Avenue	45.1	42.2	38.6	47.0	45.1	42.2	38.6	47.0					
Sprinter	38.9	38.9	35.8	43.3	38.9	38.9	35.8	43.3					
24 3.FI 48.0 45.7 42.2 50.3 48.0 45.7 42.2 50.3													
N Las Flores Drive	32.8	29.9	26.3	34.7	32.8	29.9	26.3	34.7					
S Santa Fe Avenue	47.2	44.3	40.7	49.1	47.2	44.3	40.7	49.1					
Sprinter	39.4	39.4	36.3	43.8	39.4	39.4	36.3	43.8					
25 1.FI 49.1 46.4 42.8 51.1 49.1 46.4 42.8 51.1													
N Las Flores Drive	17.8	14.9	11.3	19.7	17.8	14.9	11.3	19.7					
S Santa Fe Avenue	49.0	46.2	42.6	50.9	49.0	46.2	42.6	50.9					
Sprinter	32.6	32.6	29.6	37.0	32.6	32.6	29.6	37.0					
25 2.FI 53.7 50.9 47.3 55.7 53.7 50.9 47.3 55.7													
N Las Flores Drive	19.4	16.5	12.9	21.3	19.4	16.5	12.9	21.3					
S Santa Fe Avenue	53.6	50.8	47.1	55.5	53.6	50.8	47.1	55.5					
Sprinter	36.5	36.5	33.5	40.9	36.5	36.5	33.5	40.9					
25 3.FI 55.2 52.4 48.8 57.1 55.2 52.4 48.8 57.1													
N Las Flores Drive	23.5	20.6	17.0	25.4	23.5	20.6	17.0	25.4					
S Santa Fe Avenue	55.1	52.3	48.7	57.0	55.1	52.3	48.7	57.0					
Sprinter	36.8	36.8	33.8	41.3	36.8	36.8	33.8	41.3					
26 1.FI 52.9 50.1 46.5 54.9 52.9 50.1 46.5 54.9													
N Las Flores Drive	39.0	36.1	32.5	40.9	39.0	36.1	32.5	40.8					
S Santa Fe Avenue	52.6	49.7	46.1	54.5	52.6	49.7	46.1	54.5					
Sprinter	36.8	36.8	33.8	41.2	36.8	36.8	33.8	41.2					
26 2.FI 55.6 52.8 49.2 57.5 55.6 52.8 49.2 57.5													
N Las Flores Drive	41.0	38.2	34.5	42.9	41.0	38.1	34.5	42.9					
S Santa Fe Avenue	55.3	52.5	48.8	57.2	55.3	52.5	48.8	57.2					
Sprinter	38.6	38.6	35.6	43.0	38.6	38.6	35.6	43.0					
26 3.FI 57.4 54.7 51.0 59.4 57.4 54.7 51.0 59.4													
N Las Flores Drive	42.3	39.4	35.8	44.2	42.3	39.4	35.8	44.2					
S Santa Fe Avenue	57.2	54.4	50.8	59.1	57.2	54.4	50.8	59.1					
Sprinter	39.3	39.3	36.3	43.7	39.3	39.3	36.3	43.7					
27 1.FI 46.9 44.3 40.8 49.0 46.9 44.3 40.8 49.0													
N Las Flores Drive	33.7	30.8	27.2	35.6	33.7	30.8	27.2	35.6					
S Santa Fe Avenue	46.3	43.5	39.8	48.2	46.3	43.5	39.8	48.2					
Sprinter	35.6	35.6	32.6	40.0	35.6	35.6	32.6	40.0					
27 2.FI 51.2 48.6 45.0 53.3 51.2 48.6 45.0 53.3													
N Las Flores Drive	37.7	34.8	31.2	39.6	37.7	34.8	31.2	39.6					
S Santa Fe Avenue	50.8	47.9	44.3	52.7	50.8	47.9	44.3	52.7					
Sprinter	38.8	38.8	35.8	43.2	38.8	38.8	35.8	43.2					
27 3.FI 52.6 50.0 46.4 54.7 52.6 50.0 46.4 54.7													
N Las Flores Drive	39.4	36.5	32.9	41.3	39.4	36.5	32.9	41.3					
S Santa Fe Avenue	52.2	49.3	45.7	54.1	52.2	49.3	45.7	54.1					
Sprinter	39.9	39.9	36.9	44.3	39.9	39.9	36.9	44.3					
28 1.FI 39.8 38.0 34.6 42.6 39.8 38.0 34.6 42.6													
N Las Flores Drive	37.0	34.1	30.5	38.9	37.0	34.1	30.5	38.9					
S Santa Fe Avenue	32.8	29.9	26.3	34.7	32.8	29.9	26.3	34.7					
Sprinter	34.3	34.3	31.3	38.7	34.3	34.3	31.3	38.7					
28 2.FI 42.3 40.8 37.5 45.3 42.3 40.8 37.5 45.3													
N Las Flores Drive	38.7	35.9	32.2	40.6	38.7	35.9	32.2	40.6					
S Santa Fe Avenue	34.8	31.9	28.3	36.7	34.8	31.9	28.3	36.7					
Sprinter	38.1	38.1	35.1	42.5	38.1	38.1	35.1	42.5					
28 3.FI 46.0 43.9 40.5 48.6 46.0 43.9 40.5 48.6													
N Las Flores Drive	40.1	37.2	33.6	42.0	40.1	37.2	33.6	42.0					
S Santa Fe Avenue	43.4	40.5	36.9	45.3	43.4	40.5	36.9	45.3					
Sprinter	39.1	39.1	36.1	43.5	39.1	39.1	36.1	43.5					

10587 Santa Fe Flores Townhomes
 SoundPLAN Data - Vehicle and Rail Traffic

Source name	Noise Level without Amenity Area A Barrier				Noise Level with Amenity Area A Barrier			
	Day dB(A)	Evening dB(A)	Night dB(A)	CNEL dB(A)	Day dB(A)	Evening dB(A)	Night dB(A)	CNEL dB(A)
29 1.FI 45.4 42.7 39.1 47.4 45.4 42.7 39.1 47.4								
N Las Flores Drive	18.6	15.7	12.1	20.4	18.5	15.7	12.1	20.4
S Santa Fe Avenue	45.2	42.3	38.7	47.1	45.2	42.3	38.7	47.1
Sprinter	31.7	31.7	28.7	36.2	31.7	31.7	28.7	36.2
29 2.FI 53.6 50.8 47.2 55.5 53.6 50.8 47.2 55.5								
N Las Flores Drive	20.0	17.2	13.6	21.9	20.0	17.2	13.5	21.9
S Santa Fe Avenue	53.6	50.7	47.1	55.5	53.6	50.7	47.1	55.5
Sprinter	31.9	31.9	28.9	36.4	31.9	31.9	28.9	36.4
29 3.FI 58.3 55.4 51.8 60.2 58.3 55.4 51.8 60.2								
N Las Flores Drive	24.1	21.2	17.6	26.0	24.1	21.2	17.6	26.0
S Santa Fe Avenue	58.2	55.4	51.8	60.1	58.2	55.4	51.8	60.1
Sprinter	33.2	33.2	30.2	37.7	33.2	33.2	30.2	37.7
30 1.FI 57.5 54.7 51.0 59.4 57.4 54.5 50.9 59.3								
N Las Flores Drive	40.7	37.9	34.2	42.6	40.6	37.7	34.1	42.5
S Santa Fe Avenue	57.4	54.5	50.9	59.3	57.2	54.4	50.8	59.1
Sprinter	34.2	34.2	31.2	38.6	34.2	34.2	31.2	38.6
30 2.FI 61.0 58.2 54.6 62.9 61.0 58.1 54.5 62.9								
N Las Flores Drive	41.8	38.9	35.3	43.7	41.4	38.6	34.9	43.3
S Santa Fe Avenue	61.0	58.1	54.5	62.9	60.9	58.1	54.4	62.8
Sprinter	35.3	35.3	32.2	39.7	35.3	35.3	32.2	39.7
30 3.FI 62.9 60.1 56.4 64.8 62.9 60.1 56.4 64.8								
N Las Flores Drive	42.7	39.8	36.2	44.6	42.6	39.8	36.1	44.5
S Santa Fe Avenue	62.8	60.0	56.4	64.7	62.8	60.0	56.4	64.8
Sprinter	37.4	37.4	34.4	41.8	37.4	37.4	34.4	41.8
31 1.FI 51.7 48.9 45.3 53.6 51.6 48.8 45.2 53.5								
N Las Flores Drive	38.5	35.6	32.0	40.4	38.3	35.4	31.8	40.2
S Santa Fe Avenue	51.4	48.5	44.9	53.3	51.3	48.4	44.8	53.2
Sprinter	34.6	34.6	31.6	39.0	34.6	34.6	31.6	39.0
31 2.FI 54.1 51.3 47.7 56.1 54.0 51.3 47.7 56.0								
N Las Flores Drive	39.9	37.0	33.4	41.8	39.9	37.0	33.4	41.8
S Santa Fe Avenue	53.9	51.0	47.4	55.8	53.8	50.9	47.3	55.7
Sprinter	36.7	36.7	33.7	41.2	36.7	36.7	33.7	41.2
31 3.FI 55.8 53.1 49.5 57.8 55.6 53.0 49.4 57.7								
N Las Flores Drive	41.2	38.4	34.7	43.1	41.2	38.3	34.7	43.1
S Santa Fe Avenue	55.4	52.6	49.0	57.3	55.3	52.5	48.8	57.2
Sprinter	41.6	41.6	38.6	46.0	41.6	41.6	38.6	46.0

ATTACHMENT 5

Fresnel Barrier Reduction Calculations

10587 Santa Fe Flores Townhomes
Fresnel Barrier Reduction Calculations

Fresnel Barrier Reduction Calculations

Receiver 8, Level 2, Santa Fe Avenue

Reference Noise Level	69.2					GF = 500			
Reference Distance	104					2nd Floor = 510			
Site Conditions	Hard					Balcony Wall = 3.5			
		Distance	Distance						
Distance from Barrier to Source		from Barrier to Receiver	from Source to Receiver	Height of Source	Height of Wall	Height of Receiver	Noise Level Reduction	Unabated Noise Level	Resultant Noise Level
108		3	111	498	513.5	513	6.97	69	61.66

Receiver 8, Level 2, Las Flores Drive

Reference Noise Level	53.8					GF = 500			
Reference Distance	72					2nd Floor = 510			
Site Conditions	Hard					Balcony Wall = 3.5			
		Distance	Distance						
Distance from Barrier to Source		from Barrier to Receiver	from Source to Receiver	Height of Source	Height of Wall	Height of Receiver	Noise Level Reduction	Unabated Noise Level	Resultant Noise Level
46		3	49	504	513.5	513	7.58	57	49.56

Receiver 8, Level 2, Combined Santa Fe Avenue and Las Flores Drive

No Barrier	69.3
With Barrier	61.9
Barrier Reduction	7.4

Receiver 9, Level 3, Santa Fe Avenue

Reference Noise Level	64.7					GF = 500			
Reference Distance	151					3rd Floor = 520			
Site Conditions	Hard					Balcony Wall = 3.5			
		Distance	Distance						
Distance from Barrier to Source		from Barrier to Receiver	from Source to Receiver	Height of Source	Height of Wall	Height of Receiver	Noise Level Reduction	Unabated Noise Level	Resultant Noise Level
108		3	111	498	523.5	523	7.98	67	59.39

Receiver 9, Level 3, Las Flores Drive

Reference Noise Level	57.8					GF = 500			
Reference Distance	39					3rd Floor = 510			
Site Conditions	Hard					Balcony Wall = 3.5			
		Distance	Distance						
Distance from Barrier to Source		from Barrier to Receiver	from Source to Receiver	Height of Source	Height of Wall	Height of Receiver	Noise Level Reduction	Unabated Noise Level	Resultant Noise Level
46		3	49	504	523.5	523	9.84	56	45.98

Receiver 9, Level 3, Combined Santa Fe Avenue and Las Flores Drive

No Barrier	65.5
With Barrier	59.6
Barrier Reduction	5.9

10587 Santa Fe Flores Townhomes
Fresnel Barrier Reduction Calculations

Receiver 8, Roof Deck, Santa Fe Avenue

Reference Noise Level	69.2								
Reference Distance	104								
Site Conditions	Hard								
		Distance	Distance						
Distance from Barrier to Source		from Barrier to Receiver	from Source to Receiver	Height of Source	Height of Wall	Height of Receiver	Noise Level Reduction	Unabated Noise Level	Resultant Noise Level
108		3	111	498	533.5	533	8.98	69	59.65

GF = 500
Roof = 530
Balcony Wall = 3.5

Receiver 8, Roof Deck Las Flores Drive

Reference Noise Level	53.8								
Reference Distance	72								
Site Conditions	Hard								
		Distance	Distance						
Distance from Barrier to Source		from Barrier to Receiver	from Source to Receiver	Height of Source	Height of Wall	Height of Receiver	Noise Level Reduction	Unabated Noise Level	Resultant Noise Level
46		3	49	504	533.5	533	11.64	57	45.50

GF = 500
Roof = 530
Balcony Wall = 3.5

Receiver 8, Roof Deck, Combined Santa Fe Avenue and Las Flores Drive

No Barrier	69.3
With Barrier	59.8
Barrier Reduction	9.5

Receiver 9, Roof Deck, Santa Fe Avenue

Reference Noise Level	64.7								
Reference Distance	151								
Site Conditions	Hard								
		Distance	Distance						
Distance from Barrier to Source		from Barrier to Receiver	from Source to Receiver	Height of Source	Height of Wall	Height of Receiver	Noise Level Reduction	Unabated Noise Level	Resultant Noise Level
108		3	111	498	533.5	533	8.98	67	58.39

GF = 500
Roof = 530
Balcony Wall = 3.5

Receiver 9, Roof Deck, Las Flores Drive

Reference Noise Level	57.8								
Reference Distance	39								
Site Conditions	Hard								
		Distance	Distance						
Distance from Barrier to Source		from Barrier to Receiver	from Source to Receiver	Height of Source	Height of Wall	Height of Receiver	Noise Level Reduction	Unabated Noise Level	Resultant Noise Level
46		3	49	504	533.5	533	11.64	56	44.18

GF = 500
Roof = 530
Balcony Wall = 3.5

Receiver 9, Roof Deck, Combined Santa Fe Avenue and Las Flores Drive

No Barrier	65.5
With Barrier	58.6
Barrier Reduction	7.0

ATTACHMENT 6

FHWA RD-77-108 – Off-site Traffic Noise

**FHWA RD-77-108
Traffic Noise Prediction Model**

Data Input Sheet

Project Name : Santa Fe Flores Townhomes
Project Number : 10587
Modeled Condition : Existing

Surface Refelction: CNEL
Assessment Metric: Hard
Peak ratio to ADT: 10.0
Traffic Desc. (Peak or ADT) : ADT

Segment	Roadway	Segment	Traffic Vol.	Speed (Mph)	Distance to CL	% Autos	%MT	% HT	Day %	Eve %	Night %	K-Factor
WITHOUT PROJECT												
1	S. Santa Fe Avenue	Smilax Road to Bosstick Boulevard	14,850	45	50	95.00	3.00	2.00	77.00	10.00	13.00	
2	S. Santa Fe Avenue	Bosstick Boulevard to Community Drive	16,660	45	50	95.00	3.00	2.00	77.00	10.00	13.00	
3	S. Santa Fe Avenue	Community Drive to Las Flores Drive	16,660	45	50	95.00	3.00	2.00	77.00	10.00	13.00	
4	S. Santa Fe Avenue	Las Flores Drive to N. Rancho Santa Fe Road	14,600	45	50	95.00	3.00	2.00	77.00	10.00	13.00	
5	S. Santa Fe Avenue	N. Rancho Santa Fe Road and N. Pacific Street	13,500	40	50	95.00	3.00	2.00	77.00	10.00	13.00	
6	Hollencrest Road	De Leone Road to Hollenbeck Road	560	25	50	95.00	3.00	2.00	77.00	10.00	13.00	
7	N. Rancho Santa Fe Road	S. Santa Fe Avenue to Capalina Road	11,730	40	50	95.00	3.00	2.00	77.00	10.00	13.00	
WITH PROJECT												
1	S. Santa Fe Avenue	Smilax Road to Bosstick Boulevard	14,960	45	50	95.00	3.00	2.00	77.00	10.00	13.00	
2	S. Santa Fe Avenue	Bosstick Boulevard to Community Drive	16,770	45	50	95.00	3.00	2.00	77.00	10.00	13.00	
3	S. Santa Fe Avenue	Community Drive to Las Flores Drive	17,030	45	50	95.00	3.00	2.00	77.00	10.00	13.00	
4	S. Santa Fe Avenue	Las Flores Drive to N. Rancho Santa Fe Road	14,780	45	50	95.00	3.00	2.00	77.00	10.00	13.00	
5	S. Santa Fe Avenue	N. Rancho Santa Fe Road and N. Pacific Street	13,570	40	50	95.00	3.00	2.00	77.00	10.00	13.00	
6	Hollencrest Road	De Leone Road to Hollenbeck Road	600	25	50	95.00	3.00	2.00	77.00	10.00	13.00	
7	N. Rancho Santa Fe Road	S. Santa Fe Avenue to Capalina Road	11,840	40	50	95.00	3.00	2.00	77.00	10.00	13.00	

**FHWA RD-77-108
Traffic Noise Prediction Model**

Predicted Noise Levels

Project Name : Santa Fe Flores Townhomes
Project Number : 10587
Modeled Condition : Existing
Assessment Metric: Hard

Segment	Roadway	Segment	Noise Levels, dBA Hard				Distance to Traffic Noise Level Contours, Feet					
			Auto	MT	HT	Total	75 dB	70 dB	65 dB	60 dB	55 dB	50 dB
WITHOUT PROJECT												
1	S. Santa Fe Avenue	Smilax Road to Bosstick Boulevard	69.2	62.5	65.2	71.3	21	67	213	674	2,133	6,745
2	S. Santa Fe Avenue	Bosstick Boulevard to Community Drive	69.7	63.0	65.7	71.8	24	76	239	757	2,393	7,568
3	S. Santa Fe Avenue	Community Drive to Las Flores Drive	69.7	63.0	65.7	71.8	24	76	239	757	2,393	7,568
4	S. Santa Fe Avenue	Las Flores Drive to N. Rancho Santa Fe Road	69.2	62.4	65.1	71.2	21	66	208	659	2,084	6,591
5	S. Santa Fe Avenue	N. Rancho Santa Fe Road and N. Pacific Street	67.3	61.3	64.3	69.8	15	48	151	477	1,510	4,775
6	Hollencrest Road	De Leone Road to Hollenbeck Road	47.6	44.3	50.1	52.7	0	1	3	9	29	93
7	N. Rancho Santa Fe Road	S. Santa Fe Avenue to Capalina Road	66.7	60.6	63.7	69.1	13	41	129	406	1,285	4,064
WITH PROJECT												
1	S. Santa Fe Avenue	Smilax Road to Bosstick Boulevard	69.3	62.5	65.2	71.3	21	67	213	674	2,133	6,745
2	S. Santa Fe Avenue	Bosstick Boulevard to Community Drive	69.8	63.0	65.7	71.8	24	76	239	757	2,393	7,568
3	S. Santa Fe Avenue	Community Drive to Las Flores Drive	69.8	63.1	65.8	71.9	24	77	245	774	2,449	7,744
4	S. Santa Fe Avenue	Las Flores Drive to N. Rancho Santa Fe Road	69.2	62.4	65.2	71.3	21	67	213	674	2,133	6,745
5	S. Santa Fe Avenue	N. Rancho Santa Fe Road and N. Pacific Street	67.4	61.3	64.3	69.8	15	48	151	477	1,510	4,775
6	Hollencrest Road	De Leone Road to Hollenbeck Road	47.9	44.6	50.4	53.0	0	1	3	10	32	100
7	N. Rancho Santa Fe Road	S. Santa Fe Avenue to Capalina Road	66.8	60.7	63.8	69.2	13	42	132	416	1,315	4,159

**FHWA RD-77-108
Traffic Noise Prediction Model**

Data Input Sheet

Project Name : Santa Fe Flores Townhomes
Project Number : 10587
Modeled Condition : Near-Term (2027)

Surface Refelction: CNEL
Assessment Metric: Hard
Peak ratio to ADT: 10.0
Traffic Desc. (Peak or ADT) : ADT

Segment	Roadway	Segment	Traffic Vol.	Speed (Mph)	Distance to CL	% Autos	%MT	% HT	Day %	Eve %	Night %	K-Factor
WITHOUT PROJECT												
1	S. Santa Fe Avenue	Smilax Road to Bosstick Boulevard	16,110	45	50	95.00	3.00	2.00	77.00	10.00	13.00	
2	S. Santa Fe Avenue	Bosstick Boulevard to Community Drive	18,080	45	50	95.00	3.00	2.00	77.00	10.00	13.00	
3	S. Santa Fe Avenue	Community Drive to Las Flores Drive	18,080	45	50	95.00	3.00	2.00	77.00	10.00	13.00	
4	S. Santa Fe Avenue	Las Flores Drive to N. Rancho Santa Fe Road	15,840	45	50	95.00	3.00	2.00	77.00	10.00	13.00	
5	S. Santa Fe Avenue	N. Rancho Santa Fe Road and N. Pacific Street	14,650	40	50	95.00	3.00	2.00	77.00	10.00	13.00	
6	Hollencrest Road	De Leone Road to Hollenbeck Road	610	25	50	95.00	3.00	2.00	77.00	10.00	13.00	
7	N. Rancho Santa Fe Road	S. Santa Fe Avenue to Capalina Road	12,730	40	50	95.00	3.00	2.00	77.00	10.00	13.00	
WITH PROJECT												
1	S. Santa Fe Avenue	Smilax Road to Bosstick Boulevard	16,220	45	50	95.00	3.00	2.00	77.00	10.00	13.00	
2	S. Santa Fe Avenue	Bosstick Boulevard to Community Drive	18,190	45	50	95.00	3.00	2.00	77.00	10.00	13.00	
3	S. Santa Fe Avenue	Community Drive to Las Flores Drive	18,450	45	50	95.00	3.00	2.00	77.00	10.00	13.00	
4	S. Santa Fe Avenue	Las Flores Drive to N. Rancho Santa Fe Road	16,020	45	50	95.00	3.00	2.00	77.00	10.00	13.00	
5	S. Santa Fe Avenue	N. Rancho Santa Fe Road and N. Pacific Street	14,720	40	50	95.00	3.00	2.00	77.00	10.00	13.00	
6	Hollencrest Road	De Leone Road to Hollenbeck Road	650	25	50	95.00	3.00	2.00	77.00	10.00	13.00	
7	N. Rancho Santa Fe Road	S. Santa Fe Avenue to Capalina Road	12,840	40	50	95.00	3.00	2.00	77.00	10.00	13.00	

**FHWA RD-77-108
Traffic Noise Prediction Model**

Predicted Noise Levels

Project Name : Santa Fe Flores Townhomes
Project Number : 10587
Modeled Condition : Near-Term (2027)
Assessment Metric: Hard

Segment	Roadway	Segment	Noise Levels, dBA Hard				Distance to Traffic Noise Level Contours, Feet					
			Auto	MT	HT	Total	75 dB	70 dB	65 dB	60 dB	55 dB	50 dB
WITHOUT PROJECT												
1	S. Santa Fe Avenue	Smilax Road to Bosstick Boulevard	69.6	62.8	65.6	71.6	23	72	229	723	2,285	7,227
2	S. Santa Fe Avenue	Bosstick Boulevard to Community Drive	70.1	63.3	66.1	72.1	26	81	256	811	2,564	8,109
3	S. Santa Fe Avenue	Community Drive to Las Flores Drive	70.1	63.3	66.1	72.1	26	81	256	811	2,564	8,109
4	S. Santa Fe Avenue	Las Flores Drive to N. Rancho Santa Fe Road	69.5	62.7	65.5	71.6	23	72	229	723	2,285	7,227
5	S. Santa Fe Avenue	N. Rancho Santa Fe Road and N. Pacific Street	67.7	61.6	64.7	70.1	16	51	162	512	1,618	5,116
6	Hollencrest Road	De Leone Road to Hollenbeck Road	48.0	44.6	50.5	53.1	0	1	3	10	32	102
7	N. Rancho Santa Fe Road	S. Santa Fe Avenue to Capalina Road	67.1	61.0	64.1	69.5	14	45	141	446	1,409	4,456
WITH PROJECT												
1	S. Santa Fe Avenue	Smilax Road to Bosstick Boulevard	69.6	62.9	65.6	71.7	23	74	234	740	2,339	7,396
2	S. Santa Fe Avenue	Bosstick Boulevard to Community Drive	70.1	63.4	66.1	72.2	26	83	262	830	2,624	8,298
3	S. Santa Fe Avenue	Community Drive to Las Flores Drive	70.2	63.4	66.1	72.2	26	83	262	830	2,624	8,298
4	S. Santa Fe Avenue	Las Flores Drive to N. Rancho Santa Fe Road	69.6	62.8	65.5	71.6	23	72	229	723	2,285	7,227
5	S. Santa Fe Avenue	N. Rancho Santa Fe Road and N. Pacific Street	67.7	61.6	64.7	70.1	16	51	162	512	1,618	5,116
6	Hollencrest Road	De Leone Road to Hollenbeck Road	48.3	44.9	50.8	53.4	0	1	3	11	35	109
7	N. Rancho Santa Fe Road	S. Santa Fe Avenue to Capalina Road	67.1	61.0	64.1	69.5	14	45	141	446	1,409	4,456

**FHWA RD-77-108
Traffic Noise Prediction Model**

Data Input Sheet

Project Name : Santa Fe Flores Townhomes
Project Number : 10587
Modeled Condition : Long-Term (2050)

Surface Refelction: CNEL
Assessment Metric: Hard
Peak ratio to ADT: 10.0
Traffic Desc. (Peak or ADT) : ADT

Segment	Roadway	Segment	Traffic Vol.	Speed (Mph)	Distance to CL	% Autos	%MT	% HT	Day %	Eve %	Night %	K-Factor
WITHOUT PROJECT												
1	S. Santa Fe Avenue	Smilax Road to Bosstick Boulevard	22,200	45	50	95.00	3.00	2.00	77.00	10.00	13.00	
2	S. Santa Fe Avenue	Bosstick Boulevard to Community Drive	22,200	45	50	95.00	3.00	2.00	77.00	10.00	13.00	
3	S. Santa Fe Avenue	Community Drive to Las Flores Drive	22,200	45	50	95.00	3.00	2.00	77.00	10.00	13.00	
4	S. Santa Fe Avenue	Las Flores Drive to N. Rancho Santa Fe Road	21,300	45	50	95.00	3.00	2.00	77.00	10.00	13.00	
5	S. Santa Fe Avenue	N. Rancho Santa Fe Road and N. Pacific Street	24,400	40	50	95.00	3.00	2.00	77.00	10.00	13.00	
6	Hollencrest Road	De Leone Road to Hollenbeck Road	830	25	50	95.00	3.00	2.00	77.00	10.00	13.00	
7	N. Rancho Santa Fe Road	S. Santa Fe Avenue to Capalina Road	16,800	40	50	95.00	3.00	2.00	77.00	10.00	13.00	
WITH PROJECT												
1	S. Santa Fe Avenue	Smilax Road to Bosstick Boulevard	22,310	45	50	95.00	3.00	2.00	77.00	10.00	13.00	
2	S. Santa Fe Avenue	Bosstick Boulevard to Community Drive	22,310	45	50	95.00	3.00	2.00	77.00	10.00	13.00	
3	S. Santa Fe Avenue	Community Drive to Las Flores Drive	22,570	45	50	95.00	3.00	2.00	77.00	10.00	13.00	
4	S. Santa Fe Avenue	Las Flores Drive to N. Rancho Santa Fe Road	21,480	45	50	95.00	3.00	2.00	77.00	10.00	13.00	
5	S. Santa Fe Avenue	N. Rancho Santa Fe Road and N. Pacific Street	24,470	40	50	95.00	3.00	2.00	77.00	10.00	13.00	
6	Hollencrest Road	De Leone Road to Hollenbeck Road	870	25	50	95.00	3.00	2.00	77.00	10.00	13.00	
7	N. Rancho Santa Fe Road	S. Santa Fe Avenue to Capalina Road	16,910	40	50	95.00	3.00	2.00	77.00	10.00	13.00	

**FHWA RD-77-108
Traffic Noise Prediction Model**

Predicted Noise Levels

Project Name : Santa Fe Flores Townhomes
Project Number : 10587
Modeled Condition : Long-Term (2050)
Assessment Metric: Hard

Segment	Roadway	Segment	Noise Levels, dBA Hard				Distance to Traffic Noise Level Contours, Feet					
			Auto	MT	HT	Total	75 dB	70 dB	65 dB	60 dB	55 dB	50 dB
WITHOUT PROJECT												
1	S. Santa Fe Avenue	Smilax Road to Bosstick Boulevard	71.0	64.2	67.0	73.0	32	100	315	998	3,155	9,976
2	S. Santa Fe Avenue	Bosstick Boulevard to Community Drive	71.0	64.2	67.0	73.0	32	100	315	998	3,155	9,976
3	S. Santa Fe Avenue	Community Drive to Las Flores Drive	71.0	64.2	67.0	73.0	32	100	315	998	3,155	9,976
4	S. Santa Fe Avenue	Las Flores Drive to N. Rancho Santa Fe Road	70.8	64.0	66.8	72.9	31	97	308	975	3,083	9,749
5	S. Santa Fe Avenue	N. Rancho Santa Fe Road and N. Pacific Street	69.9	63.8	66.9	72.3	27	85	269	849	2,685	8,491
6	Hollencrest Road	De Leone Road to Hollenbeck Road	49.3	46.0	51.8	54.4	0	1	4	14	44	138
7	N. Rancho Santa Fe Road	S. Santa Fe Avenue to Capalina Road	68.3	62.2	65.3	70.7	19	59	186	587	1,858	5,874
WITH PROJECT												
1	S. Santa Fe Avenue	Smilax Road to Bosstick Boulevard	71.0	64.2	67.0	73.1	32	102	323	1,021	3,228	10,209
2	S. Santa Fe Avenue	Bosstick Boulevard to Community Drive	71.0	64.2	67.0	73.1	32	102	323	1,021	3,228	10,209
3	S. Santa Fe Avenue	Community Drive to Las Flores Drive	71.0	64.3	67.0	73.1	32	102	323	1,021	3,228	10,209
4	S. Santa Fe Avenue	Las Flores Drive to N. Rancho Santa Fe Road	70.8	64.1	66.8	72.9	31	97	308	975	3,083	9,749
5	S. Santa Fe Avenue	N. Rancho Santa Fe Road and N. Pacific Street	69.9	63.8	66.9	72.3	27	85	269	849	2,685	8,491
6	Hollencrest Road	De Leone Road to Hollenbeck Road	49.6	46.2	52.0	54.6	0	1	5	14	46	144
7	N. Rancho Santa Fe Road	S. Santa Fe Avenue to Capalina Road	68.3	62.2	65.3	70.7	19	59	186	587	1,858	5,874

ATTACHMENT 7

SoundPLAN Data – On-site Generated Noise

10587 Santa Fe Flores Townhomes

SoundPLAN Data - HVAC

Source name	Reference	Noise	Corrections		
		Level dB(A)	Cwall dB(A)	CI dB(A)	CT dB(A)
HVAC1	Lw/unit	75	-	-	-
HVAC2	Lw/unit	75	-	-	-
HVAC3	Lw/unit	75	-	-	-
HVAC4	Lw/unit	75	-	-	-
HVAC5	Lw/unit	75	-	-	-
HVAC6	Lw/unit	75	-	-	-
HVAC7	Lw/unit	75	-	-	-
HVAC8	Lw/unit	75	-	-	-
HVAC9	Lw/unit	75	-	-	-
HVAC10	Lw/unit	75	-	-	-
HVAC11	Lw/unit	75	-	-	-
HVAC12	Lw/unit	75	-	-	-
HVAC13	Lw/unit	75	-	-	-
HVAC14	Lw/unit	75	-	-	-
HVAC15	Lw/unit	75	-	-	-
HVAC16	Lw/unit	75	-	-	-
HVAC17	Lw/unit	75	-	-	-
HVAC18	Lw/unit	75	-	-	-
HVAC19	Lw/unit	75	-	-	-
HVAC20	Lw/unit	75	-	-	-
HVAC21	Lw/unit	75	-	-	-
HVAC22	Lw/unit	75	-	-	-
HVAC23	Lw/unit	75	-	-	-
HVAC24	Lw/unit	75	-	-	-
HVAC25	Lw/unit	75	-	-	-
HVAC26	Lw/unit	75	-	-	-
HVAC27	Lw/unit	75	-	-	-
HVAC28	Lw/unit	75	-	-	-
HVAC29	Lw/unit	75	-	-	-
HVAC30	Lw/unit	75	-	-	-
HVAC31	Lw/unit	75	-	-	-
HVAC32	Lw/unit	75	-	-	-
HVAC33	Lw/unit	75	-	-	-
HVAC34	Lw/unit	75	-	-	-
HVAC35	Lw/unit	75	-	-	-
HVAC36	Lw/unit	75	-	-	-
HVAC37	Lw/unit	75	-	-	-
HVAC38	Lw/unit	75	-	-	-
HVAC39	Lw/unit	75	-	-	-
HVAC40	Lw/unit	75	-	-	-
HVAC41	Lw/unit	75	-	-	-
HVAC42	Lw/unit	75	-	-	-
HVAC43	Lw/unit	75	-	-	-
HVAC44	Lw/unit	75	-	-	-
HVAC45	Lw/unit	75	-	-	-
HVAC46	Lw/unit	75	-	-	-

10587 Santa Fe Flores Townhomes

SoundPLAN Data - HVAC

No.	Coordinates		Height (meters)	Noise
	X (meters)	Y (meters)		Level dB(A)
1	481468.23	3668972.47	182.38	32.8
2	481477.03	3668933.16	185.26	34.8
3	481491.51	3668901.09	186.46	35.5
4	481513.24	3668863.85	186.82	35.3
5	481534.96	3668832.30	186.16	34.3
6	481452.72	3668803.33	161.69	33.9
7	481417.03	3668787.30	160.02	35.0
8	481389.61	3668758.33	159.84	41.9
9	481373.58	3668720.06	157.61	40.7
10	481348.75	3668660.57	154.54	35.0
11	481317.72	3668679.71	153.92	35.5
12	481280.47	3668693.16	153.14	35.8
13	481232.89	3668717.47	152.07	34.9
14	481185.82	3668741.78	151.46	33.6
15	481288.85	3668803.43	156.64	39.0
16	481306.71	3668845.77	157.91	38.0
17	481370.21	3668885.46	167.45	39.6
18	481303.57	3668756.45	154.67	38.8

Receivers

Source name	Noise Level dB(A)
1 1.FI 32.8 0.0	
HVAC1	10.9
HVAC2	11.3
HVAC3	10.7
HVAC4	12.3
HVAC5	10.8
HVAC6	9.9
HVAC7	8.0
HVAC8	7.6
HVAC9	7.4
HVAC10	5.6
HVAC11	6.3
HVAC12	6.3
HVAC13	14.7
HVAC14	15.0
HVAC15	12.6
HVAC16	10.0
HVAC17	13.2
HVAC18	15.4
HVAC19	16.1
HVAC20	16.3
HVAC21	16.5
HVAC22	15.4
HVAC23	16.3
HVAC24	16.9
HVAC25	17.5
HVAC26	18.9
HVAC27	18.7
HVAC28	17.9
HVAC29	18.3
HVAC30	18.3
HVAC31	18.5
HVAC32	18.7
HVAC33	18.7
HVAC34	18.9
HVAC35	19.2
HVAC36	19.2
HVAC37	19.2
HVAC38	19.2
HVAC39	16.8
HVAC40	16.8
HVAC41	16.9
HVAC42	16.8
HVAC43	16.8
HVAC44	16.9
HVAC45	16.8
HVAC46	16.7
2 1.FI 34.8 0.0	
HVAC1	13.7
HVAC2	15.4
HVAC3	14.9
HVAC4	15.6
HVAC5	15.6
HVAC6	12.6
HVAC7	10.1
HVAC8	10.9
HVAC9	16.3
HVAC10	7.6
HVAC11	9.0
HVAC12	7.9
HVAC13	12.6
HVAC14	14.5
HVAC15	14.9
HVAC16	11.9
HVAC17	14.8
HVAC18	12.9
HVAC19	17.2
HVAC20	18.9
HVAC21	16.9
HVAC22	17.0
HVAC23	17.6
HVAC24	18.2
HVAC25	18.8
HVAC26	20.6
HVAC27	20.1
HVAC28	19.3
HVAC29	20.7
HVAC30	19.6
HVAC31	20.6
HVAC32	21.1
HVAC33	20.8
HVAC34	21.8
HVAC35	21.4
HVAC36	21.0
HVAC37	21.4
HVAC38	21.2
HVAC39	18.3
HVAC40	18.6
HVAC41	18.7
HVAC42	19.7
HVAC43	19.0
HVAC44	18.7
HVAC45	19.6
HVAC46	19.4

Source name	Noise Level dB(A)
3 1.FI 35.5 0.0	
HVAC1	15.8
HVAC2	15.9
HVAC3	15.3
HVAC4	15.9
HVAC5	16.1
HVAC6	16.2
HVAC7	12.8
HVAC8	17.0
HVAC9	16.7
HVAC10	16.8
HVAC11	14.0
HVAC12	9.8
HVAC13	11.9
HVAC14	13.2
HVAC15	14.4
HVAC16	14.8
HVAC17	13.3
HVAC18	10.2
HVAC19	17.2
HVAC20	17.9
HVAC21	18.9
HVAC22	17.5
HVAC23	17.3
HVAC24	17.8
HVAC25	19.0
HVAC26	20.7
HVAC27	20.2
HVAC28	19.7
HVAC29	21.0
HVAC30	19.6
HVAC31	21.6
HVAC32	22.6
HVAC33	21.9
HVAC34	21.7
HVAC35	21.6
HVAC36	21.0
HVAC37	22.4
HVAC38	22.0
HVAC39	19.2
HVAC40	20.0
HVAC41	20.0
HVAC42	20.1
HVAC43	19.5
HVAC44	19.0
HVAC45	20.5
HVAC46	20.2
4 1.FI 35.3 0.0	
HVAC1	16.4
HVAC2	16.8
HVAC3	15.6
HVAC4	16.1
HVAC5	16.9
HVAC6	16.7
HVAC7	17.0
HVAC8	17.4
HVAC9	17.0
HVAC10	17.4
HVAC11	17.6
HVAC12	16.9
HVAC13	14.0
HVAC14	13.0
HVAC15	13.4
HVAC16	12.8
HVAC17	11.7
HVAC18	10.4
HVAC19	18.2
HVAC20	16.6
HVAC21	16.6
HVAC22	18.4
HVAC23	16.8
HVAC24	17.5
HVAC25	18.1
HVAC26	19.7
HVAC27	19.2
HVAC28	19.4
HVAC29	19.8
HVAC30	18.7
HVAC31	21.1
HVAC32	22.6
HVAC33	21.7
HVAC34	21.0
HVAC35	20.8
HVAC36	20.5
HVAC37	21.5
HVAC38	21.2
HVAC39	19.4
HVAC40	20.7
HVAC41	19.9
HVAC42	19.5
HVAC43	19.3
HVAC44	19.0
HVAC45	20.0
HVAC46	19.6

Source name	Noise Level dB(A)
5 1.FI 34.3 0.0	
HVAC1	16.6
HVAC2	17.0
HVAC3	15.4
HVAC4	15.9
HVAC5	17.2
HVAC6	17.0
HVAC7	17.3
HVAC8	17.8
HVAC9	16.5
HVAC10	16.9
HVAC11	17.9
HVAC12	17.4
HVAC13	15.4
HVAC14	15.3
HVAC15	14.9
HVAC16	11.7
HVAC17	13.4
HVAC18	11.5
HVAC19	16.2
HVAC20	15.8
HVAC21	15.5
HVAC22	15.7
HVAC23	16.4
HVAC24	16.3
HVAC25	16.6
HVAC26	16.9
HVAC27	17.2
HVAC28	18.0
HVAC29	18.2
HVAC30	17.2
HVAC31	20.1
HVAC32	20.6
HVAC33	19.8
HVAC34	19.5
HVAC35	19.3
HVAC36	19.2
HVAC37	20.0
HVAC38	19.6
HVAC39	18.3
HVAC40	19.8
HVAC41	18.8
HVAC42	18.7
HVAC43	18.4
HVAC44	18.2
HVAC45	19.5
HVAC46	18.9
6 1.FI 33.9 0.0	
HVAC1	19.1
HVAC2	19.7
HVAC3	20.0
HVAC4	20.6
HVAC5	20.0
HVAC6	19.7
HVAC7	19.7
HVAC8	20.9
HVAC9	21.4
HVAC10	21.6
HVAC11	20.5
HVAC12	18.2
HVAC13	16.6
HVAC14	13.1
HVAC15	12.5
HVAC16	3.4
HVAC17	7.6
HVAC18	12.8
HVAC19	7.2
HVAC20	6.5
HVAC21	6.2
HVAC22	5.5
HVAC23	6.2
HVAC24	6.8
HVAC25	6.4
HVAC26	5.1
HVAC27	4.9
HVAC28	3.7
HVAC29	4.4
HVAC30	4.8
HVAC31	7.7
HVAC32	9.1
HVAC33	10.2
HVAC34	11.5
HVAC35	13.9
HVAC36	15.6
HVAC37	12.7
HVAC38	10.8
HVAC39	12.5
HVAC40	15.4
HVAC41	19.5
HVAC42	21.6
HVAC43	23.9
HVAC44	23.6
HVAC45	20.3
HVAC46	18.1

Source name	Noise Level dB(A)
7 1.FI 35.0 0.0	
HVAC1	20.9
HVAC2	22.7
HVAC3	23.1
HVAC4	24.2
HVAC5	23.1
HVAC6	19.1
HVAC7	20.3
HVAC8	24.5
HVAC9	21.3
HVAC10	22.6
HVAC11	20.7
HVAC12	16.4
HVAC13	14.7
HVAC14	13.8
HVAC15	13.1
HVAC16	12.5
HVAC17	13.7
HVAC18	14.6
HVAC19	10.3
HVAC20	9.9
HVAC21	9.1
HVAC22	5.0
HVAC23	9.5
HVAC24	10.5
HVAC25	7.1
HVAC26	5.8
HVAC27	5.3
HVAC28	5.1
HVAC29	5.4
HVAC30	6.0
HVAC31	9.4
HVAC32	11.3
HVAC33	13.0
HVAC34	14.2
HVAC35	15.6
HVAC36	16.8
HVAC37	15.0
HVAC38	11.7
HVAC39	16.5
HVAC40	15.4
HVAC41	20.6
HVAC42	21.6
HVAC43	22.7
HVAC44	23.2
HVAC45	15.9
HVAC46	12.6
8 1.FI 41.9 0.0	
HVAC1	25.3
HVAC2	27.2
HVAC3	28.2
HVAC4	29.7
HVAC5	27.8
HVAC6	26.5
HVAC7	27.0
HVAC8	30.4
HVAC9	31.8
HVAC10	32.6
HVAC11	30.5
HVAC12	29.0
HVAC13	24.2
HVAC14	23.6
HVAC15	22.9
HVAC16	23.5
HVAC17	24.0
HVAC18	26.7
HVAC19	24.0
HVAC20	20.8
HVAC21	20.6
HVAC22	12.9
HVAC23	12.3
HVAC24	8.7
HVAC25	7.7
HVAC26	6.6
HVAC27	7.0
HVAC28	5.3
HVAC29	5.7
HVAC30	5.6
HVAC31	9.4
HVAC32	12.8
HVAC33	20.5
HVAC34	21.5
HVAC35	21.9
HVAC36	24.3
HVAC37	12.8
HVAC38	10.1
HVAC39	17.4
HVAC40	19.7
HVAC41	24.3
HVAC42	24.1
HVAC43	25.0
HVAC44	27.5
HVAC45	24.6
HVAC46	23.6

Source name	Noise Level dB(A)
9 1.FI 40.7 0.0	
HVAC1	25.3
HVAC2	29.1
HVAC3	32.7
HVAC4	32.4
HVAC5	28.9
HVAC6	25.2
HVAC7	23.8
HVAC8	27.0
HVAC9	29.9
HVAC10	28.6
HVAC11	26.2
HVAC12	24.1
HVAC13	20.3
HVAC14	15.8
HVAC15	15.2
HVAC16	14.6
HVAC17	15.8
HVAC18	17.5
HVAC19	21.4
HVAC20	19.0
HVAC21	20.1
HVAC22	20.8
HVAC23	21.8
HVAC24	20.4
HVAC25	10.5
HVAC26	18.0
HVAC27	16.2
HVAC28	16.2
HVAC29	10.1
HVAC30	6.9
HVAC31	7.8
HVAC32	9.5
HVAC33	17.7
HVAC34	18.4
HVAC35	19.3
HVAC36	17.6
HVAC37	10.4
HVAC38	10.1
HVAC39	17.6
HVAC40	18.1
HVAC41	24.4
HVAC42	20.1
HVAC43	20.7
HVAC44	23.7
HVAC45	22.0
HVAC46	22.1
10 1.FI 35.0 0.0	
HVAC1	23.2
HVAC2	23.0
HVAC3	25.5
HVAC4	24.2
HVAC5	22.0
HVAC6	20.8
HVAC7	18.4
HVAC8	19.8
HVAC9	21.7
HVAC10	21.6
HVAC11	19.3
HVAC12	17.5
HVAC13	14.7
HVAC14	14.2
HVAC15	19.8
HVAC16	14.5
HVAC17	13.5
HVAC18	12.5
HVAC19	15.5
HVAC20	16.4
HVAC21	16.2
HVAC22	14.8
HVAC23	15.7
HVAC24	14.9
HVAC25	15.2
HVAC26	12.9
HVAC27	11.5
HVAC28	11.0
HVAC29	12.0
HVAC30	14.6
HVAC31	8.1
HVAC32	8.3
HVAC33	14.8
HVAC34	15.3
HVAC35	14.1
HVAC36	13.4
HVAC37	9.6
HVAC38	9.6
HVAC39	16.7
HVAC40	16.9
HVAC41	18.7
HVAC42	20.2
HVAC43	17.3
HVAC44	19.0
HVAC45	18.8
HVAC46	18.9

Source name				Noise Level dB(A)
11	1.FI	35.5	0.0	
HVAC1				24.8
HVAC2				23.8
HVAC3				25.0
HVAC4				21.7
HVAC5				22.2
HVAC6				21.5
HVAC7				18.5
HVAC8				18.1
HVAC9				18.5
HVAC10				17.1
HVAC11				17.1
HVAC12				16.9
HVAC13				22.5
HVAC14				23.1
HVAC15				23.3
HVAC16				21.4
HVAC17				22.6
HVAC18				21.3
HVAC19				18.5
HVAC20				19.5
HVAC21				19.7
HVAC22				18.9
HVAC23				19.0
HVAC24				11.4
HVAC25				11.0
HVAC26				12.4
HVAC27				12.9
HVAC28				10.9
HVAC29				11.4
HVAC30				9.2
HVAC31				7.0
HVAC32				7.0
HVAC33				6.8
HVAC34				7.5
HVAC35				8.4
HVAC36				8.9
HVAC37				8.8
HVAC38				8.8
HVAC39				12.4
HVAC40				12.5
HVAC41				12.4
HVAC42				13.1
HVAC43				14.6
HVAC44				17.4
HVAC45				15.9
HVAC46				16.5
12	1.FI	35.8	0.0	
HVAC1				24.6
HVAC2				22.1
HVAC3				22.7
HVAC4				20.0
HVAC5				20.8
HVAC6				23.8
HVAC7				22.4
HVAC8				19.6
HVAC9				18.0
HVAC10				17.7
HVAC11				19.4
HVAC12				21.6
HVAC13				22.9
HVAC14				22.3
HVAC15				22.1
HVAC16				21.0
HVAC17				21.5
HVAC18				21.6
HVAC19				19.8
HVAC20				19.3
HVAC21				19.8
HVAC22				18.8
HVAC23				16.3
HVAC24				18.8
HVAC25				12.9
HVAC26				12.0
HVAC27				12.7
HVAC28				10.6
HVAC29				11.0
HVAC30				10.7
HVAC31				15.5
HVAC32				7.5
HVAC33				7.2
HVAC34				7.9
HVAC35				8.6
HVAC36				8.9
HVAC37				9.0
HVAC38				14.4
HVAC39				18.4
HVAC40				16.4
HVAC41				16.3
HVAC42				16.8
HVAC43				17.7
HVAC44				19.2
HVAC45				18.6
HVAC46				18.5

Source name	Noise Level dB(A)
13 1.FI 34.9 0.0	
HVAC1	22.6
HVAC2	20.1
HVAC3	19.5
HVAC4	18.4
HVAC5	19.4
HVAC6	21.8
HVAC7	21.1
HVAC8	19.1
HVAC9	18.4
HVAC10	17.8
HVAC11	18.6
HVAC12	20.1
HVAC13	20.6
HVAC14	21.2
HVAC15	24.3
HVAC16	21.3
HVAC17	19.1
HVAC18	18.2
HVAC19	19.1
HVAC20	19.5
HVAC21	18.1
HVAC22	17.5
HVAC23	19.1
HVAC24	18.2
HVAC25	11.9
HVAC26	13.9
HVAC27	16.7
HVAC28	16.0
HVAC29	14.9
HVAC30	9.8
HVAC31	10.8
HVAC32	13.7
HVAC33	9.0
HVAC34	8.4
HVAC35	8.0
HVAC36	7.8
HVAC37	10.6
HVAC38	16.5
HVAC39	16.6
HVAC40	16.5
HVAC41	15.5
HVAC42	16.1
HVAC43	16.9
HVAC44	18.2
HVAC45	16.8
HVAC46	17.7
14 1.FI 33.6 0.0	
HVAC1	18.6
HVAC2	17.5
HVAC3	17.1
HVAC4	19.4
HVAC5	17.5
HVAC6	18.4
HVAC7	18.1
HVAC8	19.8
HVAC9	19.5
HVAC10	16.6
HVAC11	20.0
HVAC12	18.8
HVAC13	18.4
HVAC14	18.5
HVAC15	19.9
HVAC16	19.4
HVAC17	18.3
HVAC18	19.5
HVAC19	16.3
HVAC20	15.9
HVAC21	17.4
HVAC22	16.9
HVAC23	15.7
HVAC24	18.1
HVAC25	18.4
HVAC26	18.5
HVAC27	16.2
HVAC28	15.6
HVAC29	14.7
HVAC30	13.7
HVAC31	9.6
HVAC32	10.4
HVAC33	9.7
HVAC34	10.8
HVAC35	9.9
HVAC36	9.0
HVAC37	12.0
HVAC38	13.8
HVAC39	15.6
HVAC40	15.8
HVAC41	15.3
HVAC42	15.6
HVAC43	15.5
HVAC44	15.7
HVAC45	15.4
HVAC46	16.9

Source name	Noise Level dB(A)
15 1.FI 39.0 0.0	
HVAC1	14.4
HVAC2	12.0
HVAC3	11.4
HVAC4	11.2
HVAC5	12.0
HVAC6	13.6
HVAC7	14.2
HVAC8	12.6
HVAC9	12.3
HVAC10	20.2
HVAC11	13.2
HVAC12	14.5
HVAC13	22.9
HVAC14	26.3
HVAC15	31.3
HVAC16	32.6
HVAC17	26.7
HVAC18	23.4
HVAC19	26.5
HVAC20	20.2
HVAC21	26.1
HVAC22	25.0
HVAC23	26.2
HVAC24	25.1
HVAC25	14.4
HVAC26	17.2
HVAC27	23.1
HVAC28	21.7
HVAC29	17.7
HVAC30	12.0
HVAC31	7.6
HVAC32	6.7
HVAC33	6.2
HVAC34	7.2
HVAC35	8.3
HVAC36	9.0
HVAC37	9.8
HVAC38	10.5
HVAC39	12.6
HVAC40	18.2
HVAC41	16.0
HVAC42	16.0
HVAC43	15.8
HVAC44	21.0
HVAC45	18.8
HVAC46	23.9
16 1.FI 38.0 0.0	
HVAC1	14.5
HVAC2	15.2
HVAC3	15.1
HVAC4	15.0
HVAC5	15.9
HVAC6	15.8
HVAC7	19.0
HVAC8	19.2
HVAC9	18.3
HVAC10	7.5
HVAC11	19.4
HVAC12	21.1
HVAC13	22.7
HVAC14	23.7
HVAC15	25.5
HVAC16	27.4
HVAC17	24.9
HVAC18	25.3
HVAC19	19.6
HVAC20	22.7
HVAC21	28.3
HVAC22	29.4
HVAC23	23.5
HVAC24	19.9
HVAC25	20.6
HVAC26	21.7
HVAC27	27.7
HVAC28	26.5
HVAC29	21.9
HVAC30	18.3
HVAC31	8.7
HVAC32	6.8
HVAC33	5.6
HVAC34	7.7
HVAC35	6.8
HVAC36	6.9
HVAC37	8.5
HVAC38	10.9
HVAC39	11.2
HVAC40	8.3
HVAC41	6.8
HVAC42	6.8
HVAC43	6.8
HVAC44	6.7
HVAC45	8.7
HVAC46	10.7

Source name			Noise Level dB(A)
17	1.FI	39.6	0.0
HVAC1			18.4
HVAC2			18.6
HVAC3			15.2
HVAC4			13.6
HVAC5			18.7
HVAC6			19.0
HVAC7			20.2
HVAC8			20.6
HVAC9			12.5
HVAC10			9.7
HVAC11			17.3
HVAC12			21.0
HVAC13			11.2
HVAC14			7.8
HVAC15			7.3
HVAC16			7.1
HVAC17			7.7
HVAC18			11.5
HVAC19			15.3
HVAC20			15.2
HVAC21			14.9
HVAC22			16.0
HVAC23			15.7
HVAC24			16.4
HVAC25			25.1
HVAC26			26.3
HVAC27			25.1
HVAC28			30.3
HVAC29			28.8
HVAC30			30.9
HVAC31			29.5
HVAC32			26.7
HVAC33			27.0
HVAC34			24.4
HVAC35			22.1
HVAC36			21.2
HVAC37			23.0
HVAC38			26.6
HVAC39			25.9
HVAC40			18.3
HVAC41			15.6
HVAC42			15.6
HVAC43			15.5
HVAC44			15.4
HVAC45			19.5
HVAC46			23.7
18	1.FI	38.8	0.0
HVAC1			29.2
HVAC2			23.9
HVAC3			22.0
HVAC4			22.1
HVAC5			24.0
HVAC6			29.5
HVAC7			29.2
HVAC8			23.7
HVAC9			22.4
HVAC10			21.3
HVAC11			23.6
HVAC12			28.1
HVAC13			26.8
HVAC14			25.0
HVAC15			27.6
HVAC16			21.7
HVAC17			22.6
HVAC18			28.7
HVAC19			12.2
HVAC20			11.8
HVAC21			12.8
HVAC22			11.4
HVAC23			9.1
HVAC24			11.0
HVAC25			7.1
HVAC26			6.5
HVAC27			7.5
HVAC28			5.7
HVAC29			5.7
HVAC30			5.2
HVAC31			5.4
HVAC32			4.9
HVAC33			4.0
HVAC34			4.5
HVAC35			5.4
HVAC36			6.0
HVAC37			6.5
HVAC38			7.7
HVAC39			11.6
HVAC40			9.5
HVAC41			9.2
HVAC42			9.8
HVAC43			11.0
HVAC44			22.4
HVAC45			12.0
HVAC46			12.2